

c.1 P. W. Dean



**SECRET**

944993

#### NOTICE

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, or any of their employees, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for any third party's use, or the results of such use, of any information, apparatus product or process disclosed in this report, or represents that its use by such third party would not infringe privately owned rights.

Available from  
Superintendent of Documents  
U.S. Government Printing Office  
Post Office Box 37082  
Washington, D.C. 20013-7982  
and  
National Technical Information Service  
Springfield, VA 22161

NUREG/CR-4543  
SAND86-0462  
RV

FIRST RESULTS FROM ELECTRON-PHOTON DAMAGE EQUIVALENCE  
STUDIES ON A GENERIC ETHYLENE-PROPYLENE RUBBER

W. H. Buckalew

April 1986

Sandia National Laboratories  
Albuquerque, NM 87185  
Operated by  
Sandia Corporation  
for the  
U.S. Department of Energy

Prepared for  
Electrical Engineering Instrumentation and Control Branch  
Division of Engineering Technology  
Office of Nuclear Regulatory Research  
U.S. Nuclear Regulatory Commission  
Washington, DC 20555  
Under Memorandum of Understanding DOE 40-550-75  
NRC FIN NO. A-1051



## ABSTRACT

As part of a simulator adequacy assessment program, the relative effectiveness of electrons and photons to produce damage in a generic ethylene-propylene rubber (EPR) has been investigated. The investigation was limited in extent in that a single EPR material, in three thicknesses, was exposed to Cobalt-60 photons and three electron beam energies.

Basing material damage on changes in the EPR mechanical properties elongation and tensile strength, we observed that EPR damage was a smoothly varying function of absorbed energy and independent of irradiating particle type. EPR damage tracked equally well as a function of both incident particle energy and material front surface dose.

Based on these preliminary data, we tentatively concluded that a correlation between particle, particle energy, and material damage (as measured by changes in material elongation and/or tensile strength) has been demonstrated.



## TABLE OF CONTENTS

	<u>Page</u>
Executive Summary. . . . .	1
1.0 Introduction . . . . .	2
2.0 Apparatus and Procedures . . . . .	5
3.0 Results. . . . .	13
3.1 Elongation and Tensile Strength versus Particle Energy . . . . .	13
3.2 Elongation and Tensile Strength versus Absorbed Energy . . . . .	15
3.3 Elongation and Tensile Strength versus Front Surface Dose . . . . .	19
3.4 Photon to Electron Relative Effectiveness Estimates. . . . .	19
4.0 Conclusions. . . . .	24
References. . . . .	28

## LIST OF FIGURES

	<u>Page</u>
1. Beta Particle Time-Dependent Average Energy. . . . .	3
2. Reactor Containment Volume Beta Particle Radiation Environment. . . . .	4
3. Schematic of Experiment Orientation. . . . .	6
4. Calculated Electron and Photon Energy Deposition in Ethylene-Propylene Rubber Insulation . . . . .	9
5. Material Elongation versus Particle Energy- Averaged Data . . . . .	14
6. Material Elongation versus Particle Energy . . . . .	16
7. Material Tensile Strength versus Particle Energy- Averaged Data . . . . .	17
8. Material Tensile Strength versus Particle Energy . . . . .	18
9. Material Elongation versus Absorbed Energy . . . . .	20
10. Material Tensile Strength versus Absorbed Energy . . . . .	21
11. Material Elongation versus Front Surface Dose. . . . .	22
12. Material Tensile Strength versus Front Surface Dose. . . . .	23
13. Photon to Electron Effectiveness Ratio - Elongation Estimate. . . . .	25
14. Photon to Electron Effectiveness Ratio - Tensile Strength Estimate. . . . .	26



## LIST OF TABLES

	<u>Page</u>
1. Energy Deposition Synopsis - 0.10 cm EPR Slab. . . . .	10
2. Energy Deposition - All Slab Thicknesses . . . . .	10
3. Front Surface Dose - All Slab Thicknesses. . . . .	12

## ACKNOWLEDGMENT

The author would like to gratefully acknowledge the valuable technical assistance provided by S. M. Luker during the course of this work.

## EXECUTIVE SUMMARY

As part of a study on the adequacy of cobalt-60 sources to simulate the radiation damage to organic materials exposed to the mixed radiation environment accompanying a nuclear power plant loss of coolant accident (LOCA), the "equivalence" of electron and photon induced damage in a generic ethylene propylene rubber (EPR) insulation material exposed to cobalt-60 photons and accelerator produced electron beams was investigated.

Electron beam induced material damage was studied as a function of three EPR thicknesses, three electron beam energies, and one dose-rate and integrated dose. EPR thicknesses were selected as being representative of those used in electrical cable insulation applications. Likewise, electron beam energies were chosen to be comparable to those predicted for a LOCA event. The electron beam dose-rate was also chosen on the basis of estimated LOCA dose-rates, and the integrated dose was selected to balance the need for statistically significant material damage and reasonable electron beam exposure times. Cobalt-60 irradiations, equivalent to the electron beam exposure dose and dose-rate, were obtained for the material damage equivalence evaluation.

Damage to irradiated materials was based on a technique frequently used to gauge the effects of radiation aging on Class 1E elastomeric materials; i.e. changes in elongation and tensile strength of the irradiated specimens. Analyses of the radiation exposure data suggest that the observed material damage is a slowly varying function of absorbed energy and independent of particle type within experimental uncertainty. Absorbed energy, particle energy, and surface dose are all interrelated parameters, and the data analysis on the basis of each of these parameters yields similar results. From these data an estimate of photon to electron relative (damage) effectiveness was obtained. The ratio lies between 0.94 and 1.04 over the range of parameters considered to date.

More extensive studies are required to reach conclusions applicable to other materials and radiation exposure conditions. In particular, the study should consider (at least one) other material, extend the electron energy to lower values and the total dose to higher values, and evaluate the effect of dose rate. Consideration of an additional material would provide a check on the uniqueness of the results presented here. Extension of the electron energy to lower values may provide a cut-off energy below which incident particles could be neglected. Larger total absorbed doses would allow determination of the influence of degradation extent. Dose-rate data would establish a saturation effect, if there is one and perhaps provide a measure of dose-rate influence on the damage effectiveness of electron beam irradiations as a function of beam energy.

## 1. INTRODUCTION

It is the general practice in the qualification testing of safety-related systems and components to simulate reactor containment volume radiation environments, resulting from loss of coolant accidents (LOCA), with isotopic photon irradiators. Implicit here is the assumption that discrete energy, steady-state photon sources will adequately simulate a complex radiation environment composed of electron and photon components each with its own time dependent energy spectrum and emission rate.

In view of the complexity of the accident radiation environment, the adequacy of isotopic photon irradiators to simulate the accident conditions has been periodically questioned. It has been our contention<sup>1</sup> that equivalence exists between electron and photon radiation effects provided certain conditions are satisfied. On a microscopic scale, we believe equivalence is likely present provided equal energy absorption occurs with either electron or photon bombardment. On a macroscopic scale, however, nonequivalence of electron/photon bombardment may be observed. Several factors may influence equivalence and include, for example, (1) differences in energy deposition profiles between electrons and photons, (2) differences in material response (energy deposition), per unit dosimeter response, as a function of irradiating particle type, and (3) different damage mechanisms (such as crosslinking, charge buildup and/or breakdown, etc.). On the other hand, irradiated material properties may be so insensitive to the type and energy of the incident radiation that these parameters--energy, particle-type, etc.--are mere nuances as far as damage studies are concerned. Our intent was to identify the degree to which each of these functions influence damage equivalence in certain organic materials.

Recently we completed a scoping study on the relative effectiveness of electron and photon bombardment in producing radiation damage in a rubber insulation material. We examined the response of a generic EPR rubber,<sup>2</sup> in slab geometry, to both cobalt-60 photons ( $E$  (ave) = 1.25 MeV) and several different energy electron beams. Rubber thicknesses were 0.1, 0.15, and 0.2 cm; this is the thickness range frequently used in electrical insulation applications. Electron energies considered spanned the range between 0.235 and 0.85 MeV and were based on beta particle average energy estimates for in-containment radiation environments resulting from a LOCA radiation release. For comparison with our choice of energies those calculated average energy estimates for a beta particle LOCA radiation environment are presented in Figure 1.<sup>3</sup> The electron dose-rate and integrated dose were fixed at 2 Mrad/hr and 10 Mrad respectively and both were chosen somewhat arbitrarily. As may be observed from the calculated LOCA dose-rate/dose plot, Figure 2,<sup>4</sup> the 2 Mrad/hr electron dose rate occurs at an integrated dose of approximately 100 Mrads--well

AVERAGE BETA PARTICLE ENERGY  
as a function of  
REACTOR COOLING TIME

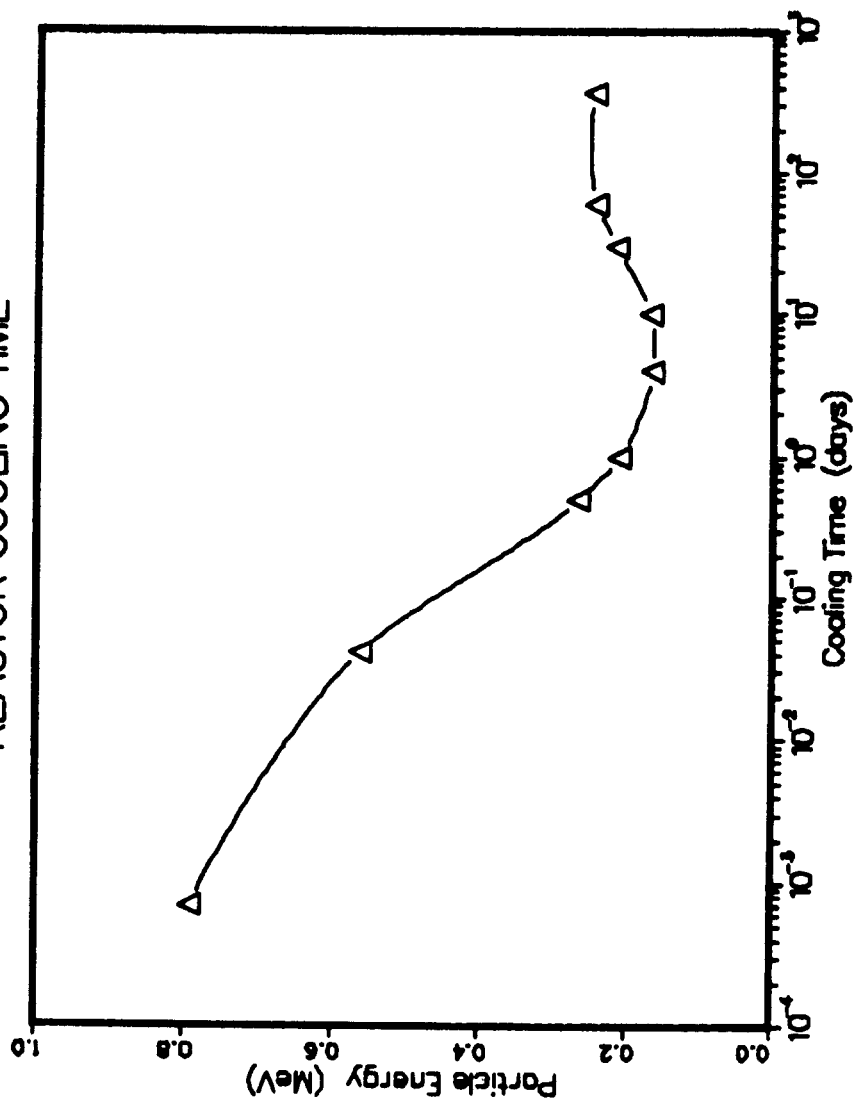


Figure 1: Beta Particle Time-Dependent Average Energy

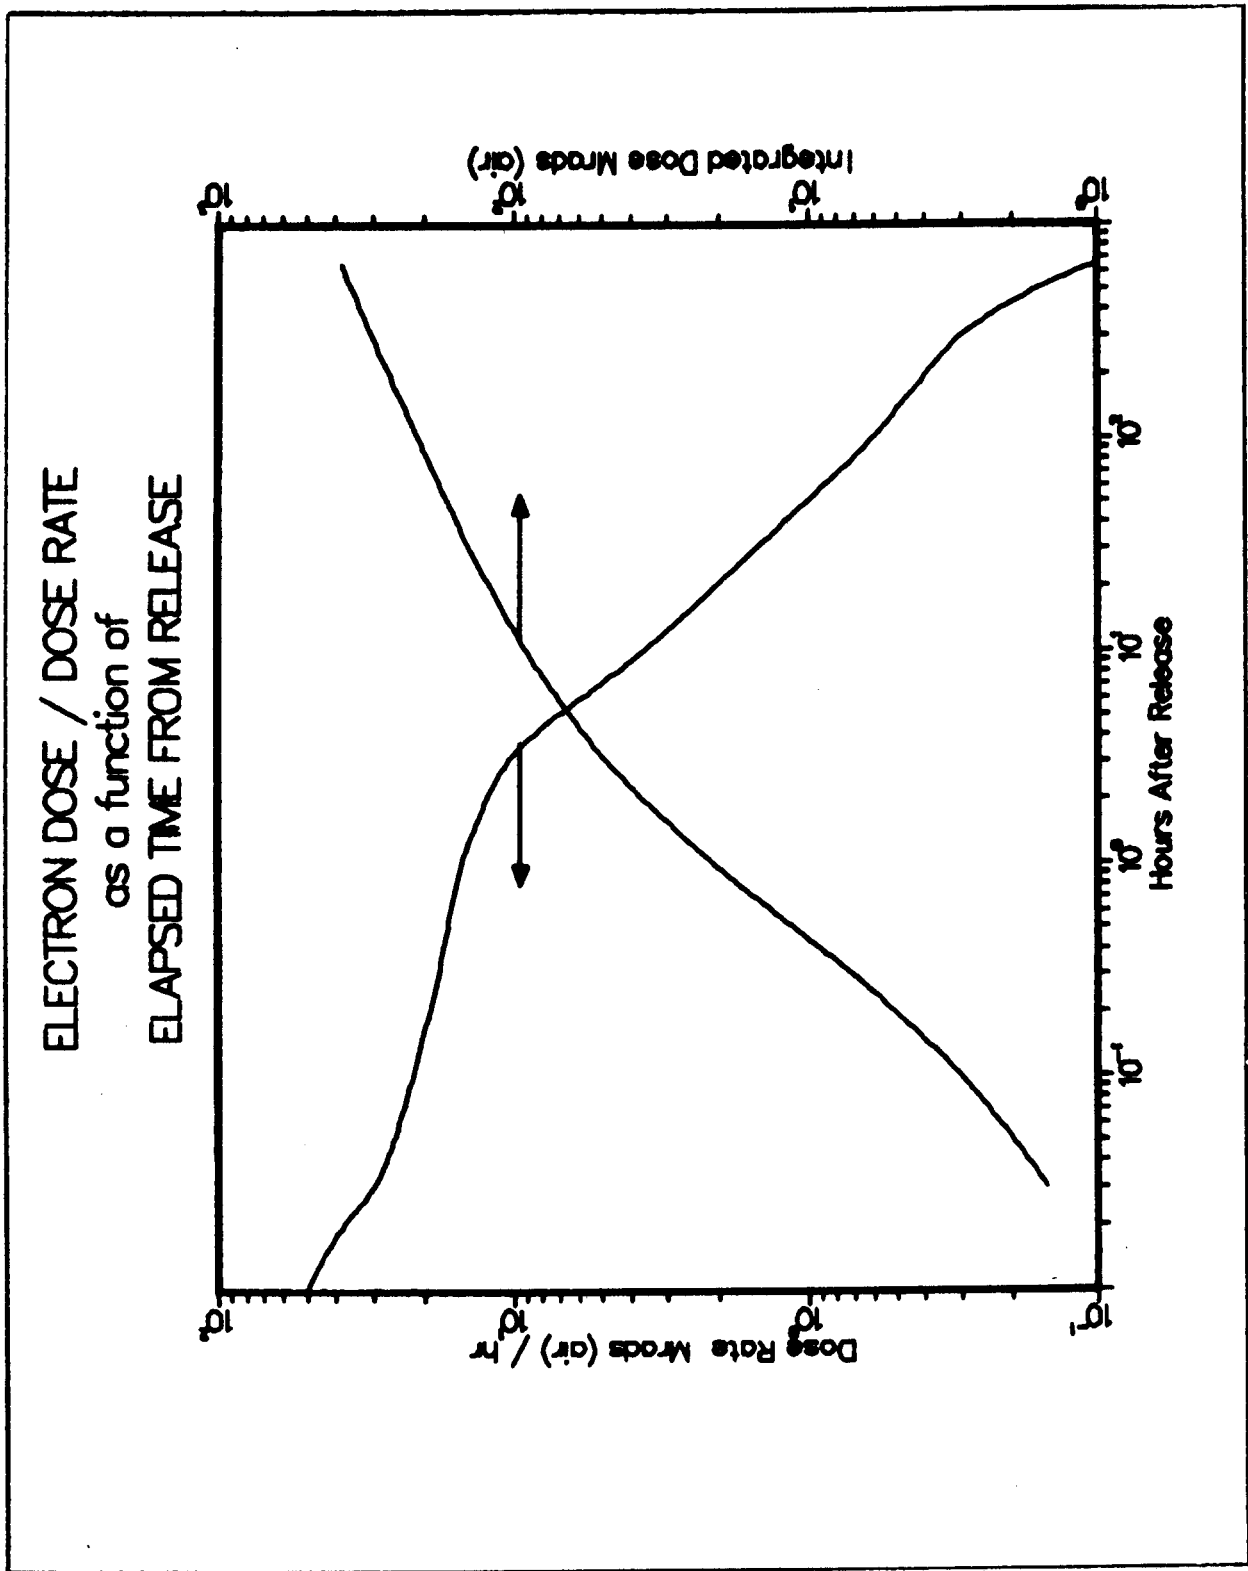


Figure 2: Reactor Containment Volume Beta Particle Radiation Environment

within the LOCA dose-rate versus time profile. The integrated dose was selected on the basis of consistent material properties degradation and reasonable radiation exposure times.

Complimentary to the experiments, we calculated the EPR response to both photon and electron beams as energy deposition profiles, sample front surface dose, and total energy absorption. In addition, response of the dosimetry material used in the study was also calculated. The calculated EPR response allowed correlation of observed EPR damage to front surface dose, etc. Calculated dosimetry response provided correlation between calculated photon and electron results just as dosimetry measurements provided a link between observed photon and electron induced damage.

The following sections of the report detail the electron/photon scoping study. Included are discussions of the experimental procedures, experimental and calculated results, and conclusions.

## 2. APPARATUS AND PROCEDURES

We used a PELLETRON\* electron beam accelerator to produce the electron beam exposures for our experiments. The electron energy range is continuously variable between 0.025 and 1.15 MeV, and beam current is adjustable up to a maximum of 34 microamperes. Uncertainties in the machine parameters (voltage regulation and ripple) were carefully determined such that the electron beam energy was known to within approximately 0.5 percent.<sup>5</sup> Total beam current was measured with an in-line Faraday Cup positioned at the accelerator exit and just inside the integral vacuum chamber. Additional current sensitive elements were positioned within the vacuum chamber as aids in controlling the electron beam trajectory. In Figure 3 a schematic of the accelerator, integral vacuum chamber, and external fixturing are depicted. All internal and external elements are positioned along a common centerline that is also colinear with the required electron beam trajectory. In the vacuum chamber, maximum current into the deflection coils is obtained by minimizing current detected by the focussing and alignment apertures. The normally tight electron beam is then deflected into a square pattern and transported into the ambient environment through a 0.005 cm (0.002 in) beryllium window. Deflection system performance has been well characterized<sup>6</sup> as a function of electron beam energy, beam pattern size required, etc. Fixturing external to the vacuum chamber consists of a beryllium shutter, beryllium back plane, and

---

\* Manufactured by National Electrostatics Corp., Middleton, WI

# PELLETRON - EXTERNAL FIXTURING ASSEMBLY

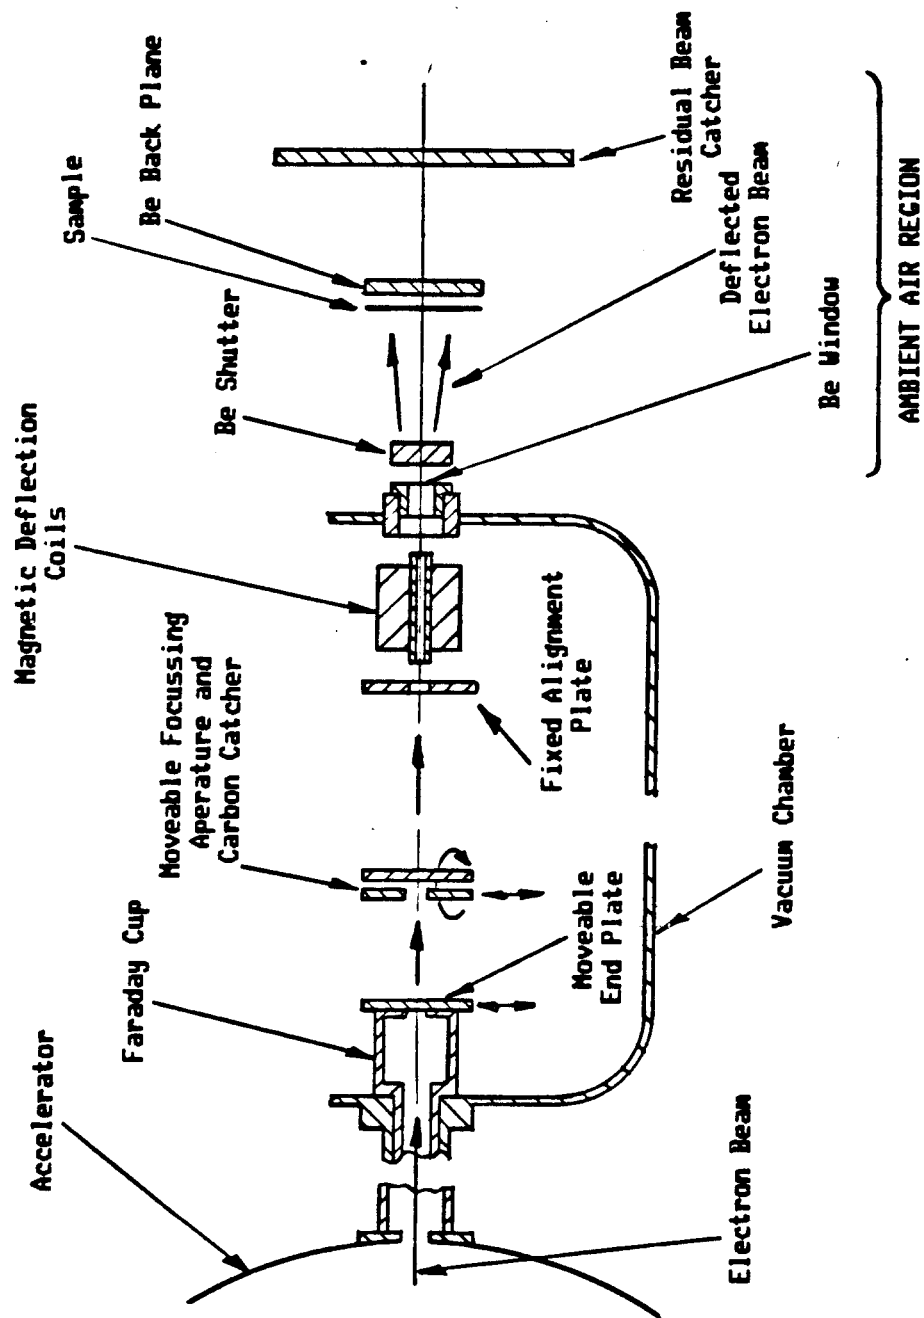


Figure 3. Schematic of Experiment Orientation



a residual beam catcher. The purpose of the beryllium shutter is twofold--to detect the total beam transported through the beryllium window and isolate target materials from the electron beam during minor beam steering adjustments. The beryllium back plane functions primarily to detect current in the target plane both with and without a test specimen in position. The residual beam catcher functions mainly as a check on current conservation in the ambient environment. Each current detecting element in the array is monitored with an analogue electrometer system. Position of the target plane (beryllium back plane) with respect to the beryllium exit window is determined, primarily, on the basis of geometric considerations. Given the maximum (line-of-sight) dimension subtended from the deflection coil center to the beryllium exit window allows estimation of the window-target plane separation required for a given target specimen size. Some adjustments in window-target plane separation are occasionally required to enhance beam uniformity in the target plane.

Photon exposures were obtained using the Sandia Laboratories North Gamma Irradiation Facility (NGIF). In essence, the facility consists of a dry irradiation cell (cubical in shape) and companion rectangular array (12 x 10 x 7 inches) of cobalt-60 pencils. The source array consists of 64 pencils with total source strength of approximately 55 kilocuries. Dose rate in the vicinity of the 10 x 12 inch surface is in excess of 2.5 Mrad (air)/hr.

Extensive electron and photon dosimetry measurements were made prior to the effects experiments. The electron beam pattern size and uniformity data were obtained using thin dye loaded plastic detector material. Detector material response measurements and calibration techniques are similar to those described in Reference 6. In addition to thin film dosimetry determinations, we converted beryllium back plane current measurements into dose-rate values using calculated energy absorption coefficients in a manner analogous to those techniques reported in Reference 6. Photon beam pattern size, uniformity, and dose were also obtained using the thin film dosimetry. Use of identical dosimetry methods, for both electron and photon measurements, allowed for direct comparison of radiation effects data for "equivalence" purposes.

Average electron beam energy incident on the target plane was calculated using the coupled electron-photon transport code, TIGER.<sup>7</sup> Using, as input, the in vacuo electron beam energy determined from the accelerator adjustable parameters, the target plane beam energy was calculated on the basis of beam transport through the beryllium window and intervening window-target plane air gap. In addition to electron spectral data, the calculations yielded test specimen energy deposition data, dosimetry material response, etc. These data were used in minor adjustments of

input energy and air gap dimension to obtain the desired beam energy at the target plane and yet achieve acceptable beam uniformity across the target plane. Similar calculations were required to obtain energy deposition estimates for samples irradiated in the NGIF Co<sup>60</sup> facility. As in the case of the electron beam calculations, we included the effects of intervening material on the deposition results. In this instance, we included the source pencil cladding material as well as the intervening air gap. Likewise, target geometries and compositions were identical to those used in the experiments. Some results of these calculations are given in Figure 4 and Tables 1 and 2. In Figure 4 energy deposition results for ethylene-propylene rubber (EPR) are presented. Plotted are deposition data for three electron energies and Co<sup>60</sup> photons. The listed electron energies are spectral averaged values, whereas the photon value is merely the simple average (1.25) of the two emission lines, i.e., 1.33 and 1.18 Mev. In the figure, the energy deposition values have been normalized on the basis of the thin film detector calculated response. This normalization allows for direct comparison of all observed radiation damage, independent of particle type or energy. We note from the figure that the electron energy deposition profiles are strongly dependent on the electron beam energy, whereas the extrapolated front surface doses are clustered rather closely about a single value.

A compilation of calculated energy deposition data for 0.10 cm (thick) EPR and detector (dosimeter) material is given in Table 1. It may be noted, in columns 2, 3, and 4, that the calculated energy deposition results are presented on the basis of one incident particle (MeV/pr, etc.). Experimentally, electron energy deposition determinations are quickly obtained from electron particle (current) measurements in conjunction with calculated data similar to that given in columns 2, 3, and 4. On the other hand direct determination of high intensity photon particle fluence is not readily obtainable. Hence, we use thin film dosimetry, the detector, as a link between electron and photon exposures rather than particle fluence. In columns 5 and 6 absorbed energy and front surface dose values, based on the detector dose, are tabulated. All absorbed energy and front surface dose values used throughout this report are based on detector response rather than incident particle values.

Calculated energy deposition results, for all material thicknesses, are presented in Table 2. Tabulated are absorbed energy values, per unit detector dose, for each energy particle and EPR thickness. Energy absorption values are based on unit material thickness. We note, from Figure 4, that in several instances sample thickness is greater than the incident particle range and in others particle range is much greater than sample thickness. Further, material degradation is a function of

# ENERGY DEPOSITION as a function of PENETRATION DEPTH

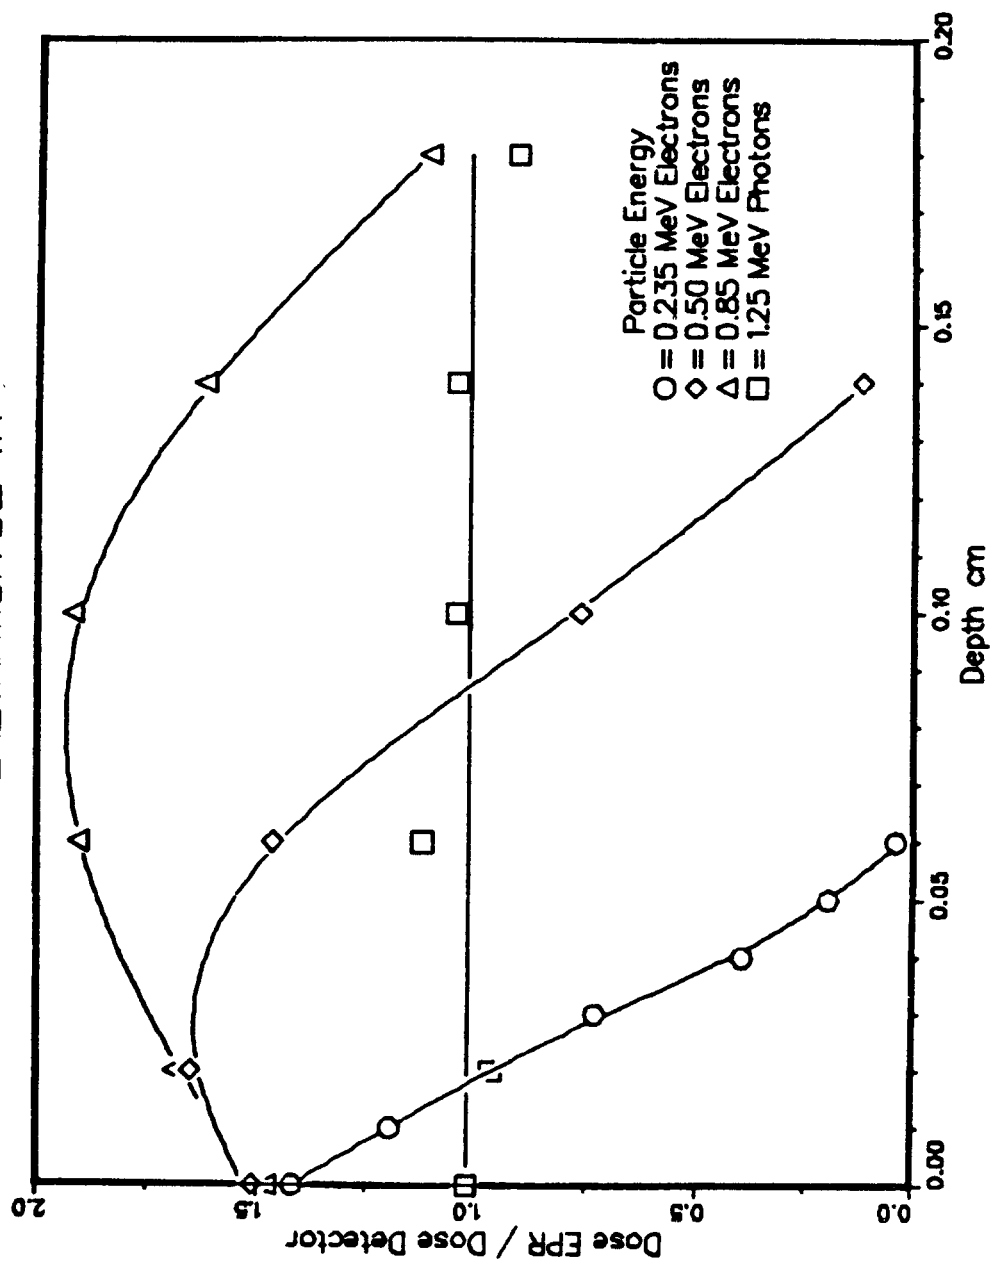


Figure 4: Calculated Electron and Photon Energy Deposition in Ethylene-Propylene Rubber Insulation

Table 1. Energy Deposition Synopsis - 0.10 cm EPR Slab

Particle Energy	Energy Absorbed	Front Surface Dose	Detector Dose	$\frac{\text{Energy Absorbed}}{\text{Detector Dose}}$	$\frac{\text{Front Surface Dose}}{\text{Detector Dose}}$
MeV	MeV/pr	MeV/gm-pr	MeV/gm-pr	MeV/(MeV/gm)	(MeV/gm)/(MeV/gm)
0.235 $e^-$	0.178	4.89	3.42	0.052	1.42
0.50 $e^-$	0.422	3.79	2.53	0.167	1.50
0.85 $e^-$	0.388	2.80	1.88	0.206	1.49
1.25 $\gamma$	0.0037	0.0342	0.035	0.106	0.974

Table 2. Energy Deposition - All Slab Thicknesses

Particle Energy MeV	Energy Absorbed / Detector Dose / cm MeV/(MeV/gm)/cm		
0.235 $e^-$	0.52	0.347	0.26
0.50 $e^-$	1.67	1.27	0.955
0.85 $e^-$	2.06	2.07	1.94
1.25 $\gamma$	1.06	1.10	1.19
	Slab Thickness (cm)	0.10	0.15 0.20

absorbed energy. In order to more clearly illustrate the effects of absorbed energy on material mechanical properties, all plots of material change, as a function of absorbed energy, are on the basis of absorbed energy per unit material thickness.

Extrapolated front surface dose data are listed in Table 3. From the table it is noted that extrapolated front surface dose is not particularly sensitive to the incident electron beam energy or sample thickness. We observe, however, that the photon results are approximately fifty percent lower than the electron values. Since material damage, as indicated by changes in elongation and tensile strength, may be dependent on particle energy and sample thickness and in order to demonstrate that dependence, we have tabulated front surface dose data on the basis of unit detector dose and material thickness. Plots of damage versus extrapolated front surface dose presented elsewhere, in this report, are also plotted as a function of normalized front surface dose.

For this study, a single (type) insulation material in one geometry was considered. The target material used in this study was a generic EPR rubber insulation material (#1482) compounded from an "in-house" formulation.<sup>2</sup> The material was cast into a slab geometry with 15 cm lateral dimensions. Three sample thicknesses were used--0.1, 0.15, and 0.20 cm.

Full, 15 x 15 cm EPR slabs were used in all radiation exposures. Integrated dose and dose-rate were fixed, for all irradiations, at 10.0 Mrad(air) and 2.0 Mrad(air)/hr respectively. Dose and dose-rate measurements were obtained, with calibrated thin film dosimetry, for each particle type and energy prior to any EPR exposures. Calibration of the film dosimetry was on the basis of dose to air and subsequent EPR irradiation doses were done in terms of exposure dose to air.

Radiation aging effects on bulk elastomeric materials, used in Class 1E cables, are generally gauged on the basis of changes in mechanical properties of the radiation stressed material. Two frequently used indicators of radiation damage are changes in material elongation and tensile strength. In this investigation normalized elongation,  $e/e_0$ , and normalized tensile strength,  $T_s/(T_{s0})$ , were used as indicators of damage in irradiated EPR specimens. Irradiated samples were sectioned into test specimens 15 centimeters long by 0.625 centimeters wide. Ten specimens were taken from each sample for tensile measurements. Tensile measurements (elongation and ultimate strength) were obtained with an Instron 1000 Universal test machine using a continuous tape extensiometer graduated in 0.1 inch increments.

Table 3. Front Surface Dose - All Slab Thicknesses

Particle Energy MeV	Front Surface Dose / Detector Dose / cm ((MeV/gm) / (MeV/gm)) / cm		
0.235 $e^-$	14.20	9.46	7.10
0.50 $e^-$	15.00	10.00	7.50
0.85 $e^-$	14.90	9.93	7.45
1.25 $\gamma$	9.74	6.49	4.87
Slab Thickness (cm)	0.10	0.15	0.20

### 3. RESULTS

#### 3.1 Elongation and Tensile Strength Versus Particle Energy

Radiation exposure conditions and EPR sample data have appeared elsewhere throughout the report. For convenience, the data are summarized as follows. All samples were exposed, in air at ambient pressure and temperature, to a fixed integrated dose and dose rate of 10 Mrad and 2 Mrad/hr respectively. Experimental dose measurements were determined with thin film dosimetry calibrated against an air ionization chamber. Both elongation and tensile strength data were normalized on the basis of unirradiated sample results-- $e/e_0$  and  $TS/TS_0$ .

Elongation results are depicted in Figure 5, Plots A and B. Consider Plot A first. In Plot A normalized elongation data are plotted as a function of incident particle energy. Electron results appear as open circles and photon data as the open square. Each elongation value is the average elongation value for all material thicknesses irradiated at that particle energy. Error bars on the data are one standard deviation values. The solid curve drawn through the electron data is used to depict the trend of the electron data. We observe from the curve that material elongation is a slowly varying (decreasing) function of increasing electron energy. These electron data are consistent with the concept that increasing particle energy results in increasing material damage; i.e., decreasing elongation. It may be observed that the photon data, the open square, does not track with the trend determined from the electron data.

Energy deposition in materials from photon irradiations is primarily the result of recoil electron energy loss in the irradiated material. The relationship of electron induced degradation to photon degradation data, based on the photon recoil electron energy, is given in Plot B, Figure 5. In Plot B, Figure 5, we have again plotted the electron data as the open circles with the solid curve depicting the trend of that data. The photon recoil electron data are represented by the square symbols.

Two recoil electron energies were considered; in one case the recoil electron energy was estimated on the basis of photon absorption and total cross sections and in the other on the basis of a TIGER prediction of the recoil electron distribution within an EPR sample bombarded with 1.25 MeV photons. The average electron energy based on photon cross section is 0.58 MeV; and when the TIGER estimate is used, the average recoil electron energy is 0.45 MeV.

# ELONGATION as a function of INCIDENT PARTICLE ENERGY

PLOT A

PLOT B

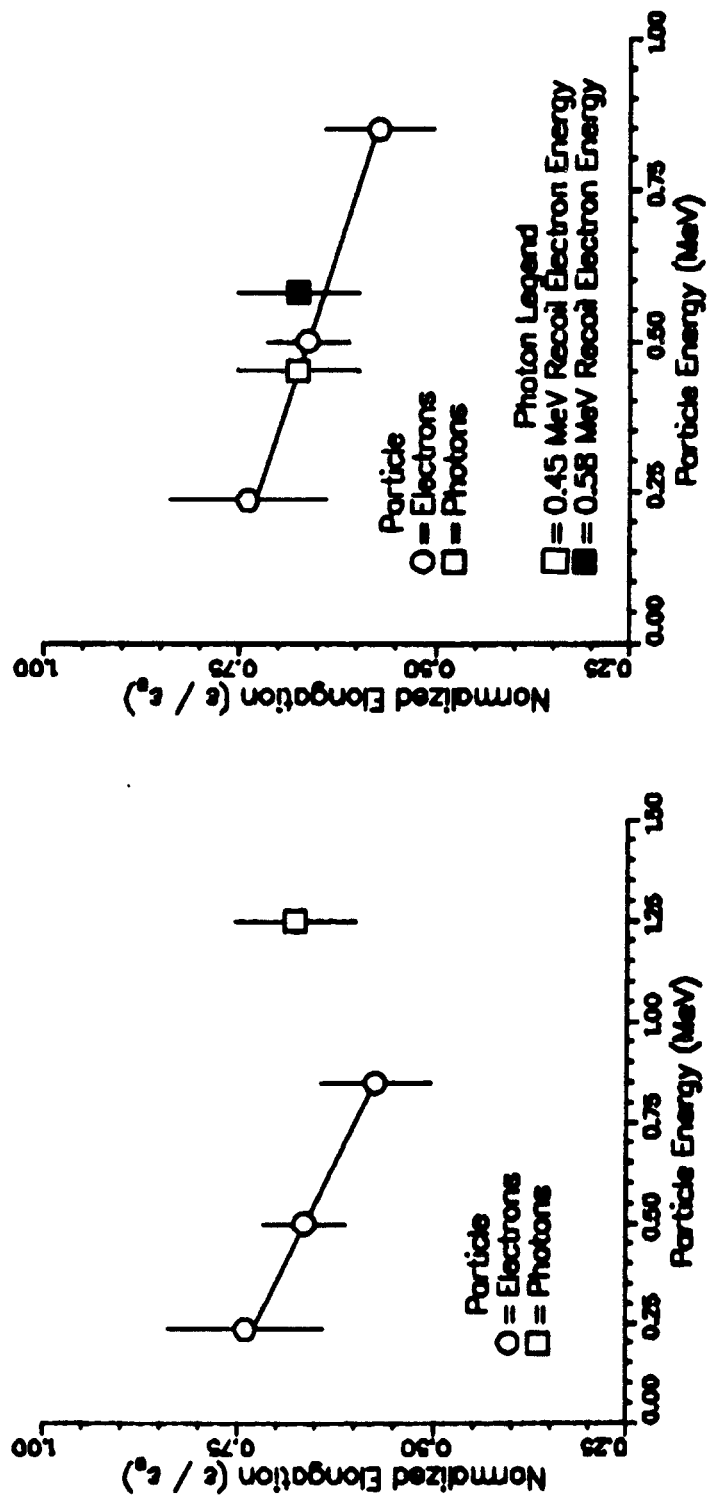


Figure 5: Material Elongation versus Particle Energy-Averaged Data



In Plot B, material elongation as a function of electron energy, based on the cross-section approximation, is plotted as the closed square. Data plotted on the basis of the TIGER estimate are depicted by the open square. When the photon elongation data are plotted as a function of either estimated recoil electron energy, we observe that the photon induced degradation data are in reasonable agreement with the electron degradation data. Subsequent photon degradation data are plotted as a function of the TIGER estimated recoil electron energy.

Material elongation data, depicting individual thickness data, are plotted in Figure 6. In the figure photon elongation data have been plotted as a function of the recoil electron energy estimated on the basis of the TIGER calculation. Open, closed, and half-open symbols identify sample thickness as 0.1, 0.15, and 0.2 cm respectively. Error bars on individual data points are one standard deviation estimates. The solid curve is again an estimate of the degradation trend as a function of particle energy. With the exception of the data point at 0.235 MeV and 0.93 elongation (the closed circle, sample thickness = 0.15), all data were reasonably well-represented by the estimated trend. We note that the material thickness corresponding to the suspect data is bound by two sample thicknesses (0.1 and 0.2 cm) with more consistent data points. We intend to further investigate this apparent anomolous data point in our (proposed) program designed to study the effects of lower (below 0.235 MeV) energy electrons.

Tensile strength data, as a function of incident particle energy, are presented in Figures 7 and 8. The data presented in Figure 7 have been averaged over all material thicknesses for each particle energy. Electron data are depicted by the open circles, and the photon data is represented by the square symbol. Trend of the electron data is indicated by the solid curve. The photon data, square symbol, has been plotted as a function of the  $\text{Co}^{60}$  photon recoil electron average energy, as estimated by the TIGER calculations. We note that the photon degradation data are in reasonable agreement with the electron data. The degradation trend, depicted by the solid curve, suggests that tensile strength is a slowly increasing function of incident particle energy. Tensile strength data for all particle energies and each material thickness are given in Figure 8. Electron data are depicted by the circles, and photon data is represented by the square symbol.

### 3.2 Elongation and Tensile Strength versus Absorbed Energy

In order to determine the trend of energy absorption on material degradation, elongation and tensile strength data

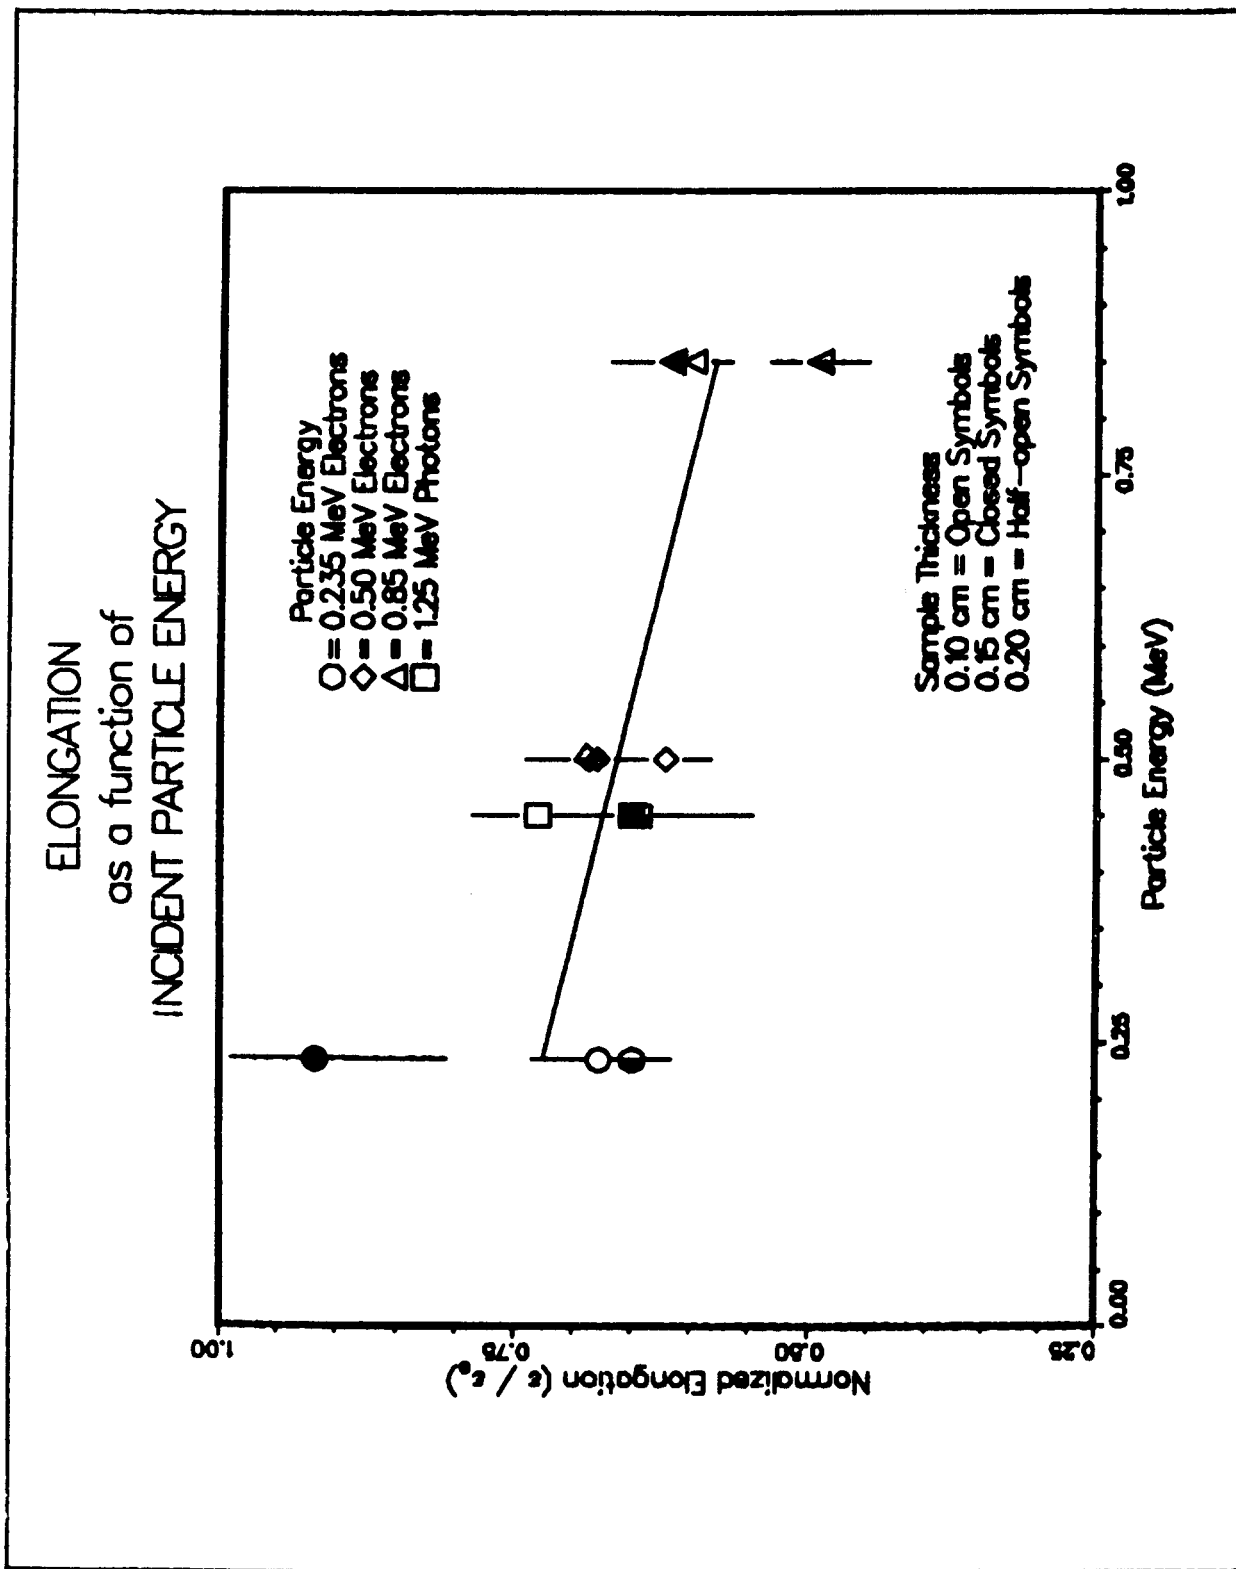


Figure 6: Material Elongation versus Particle Energy

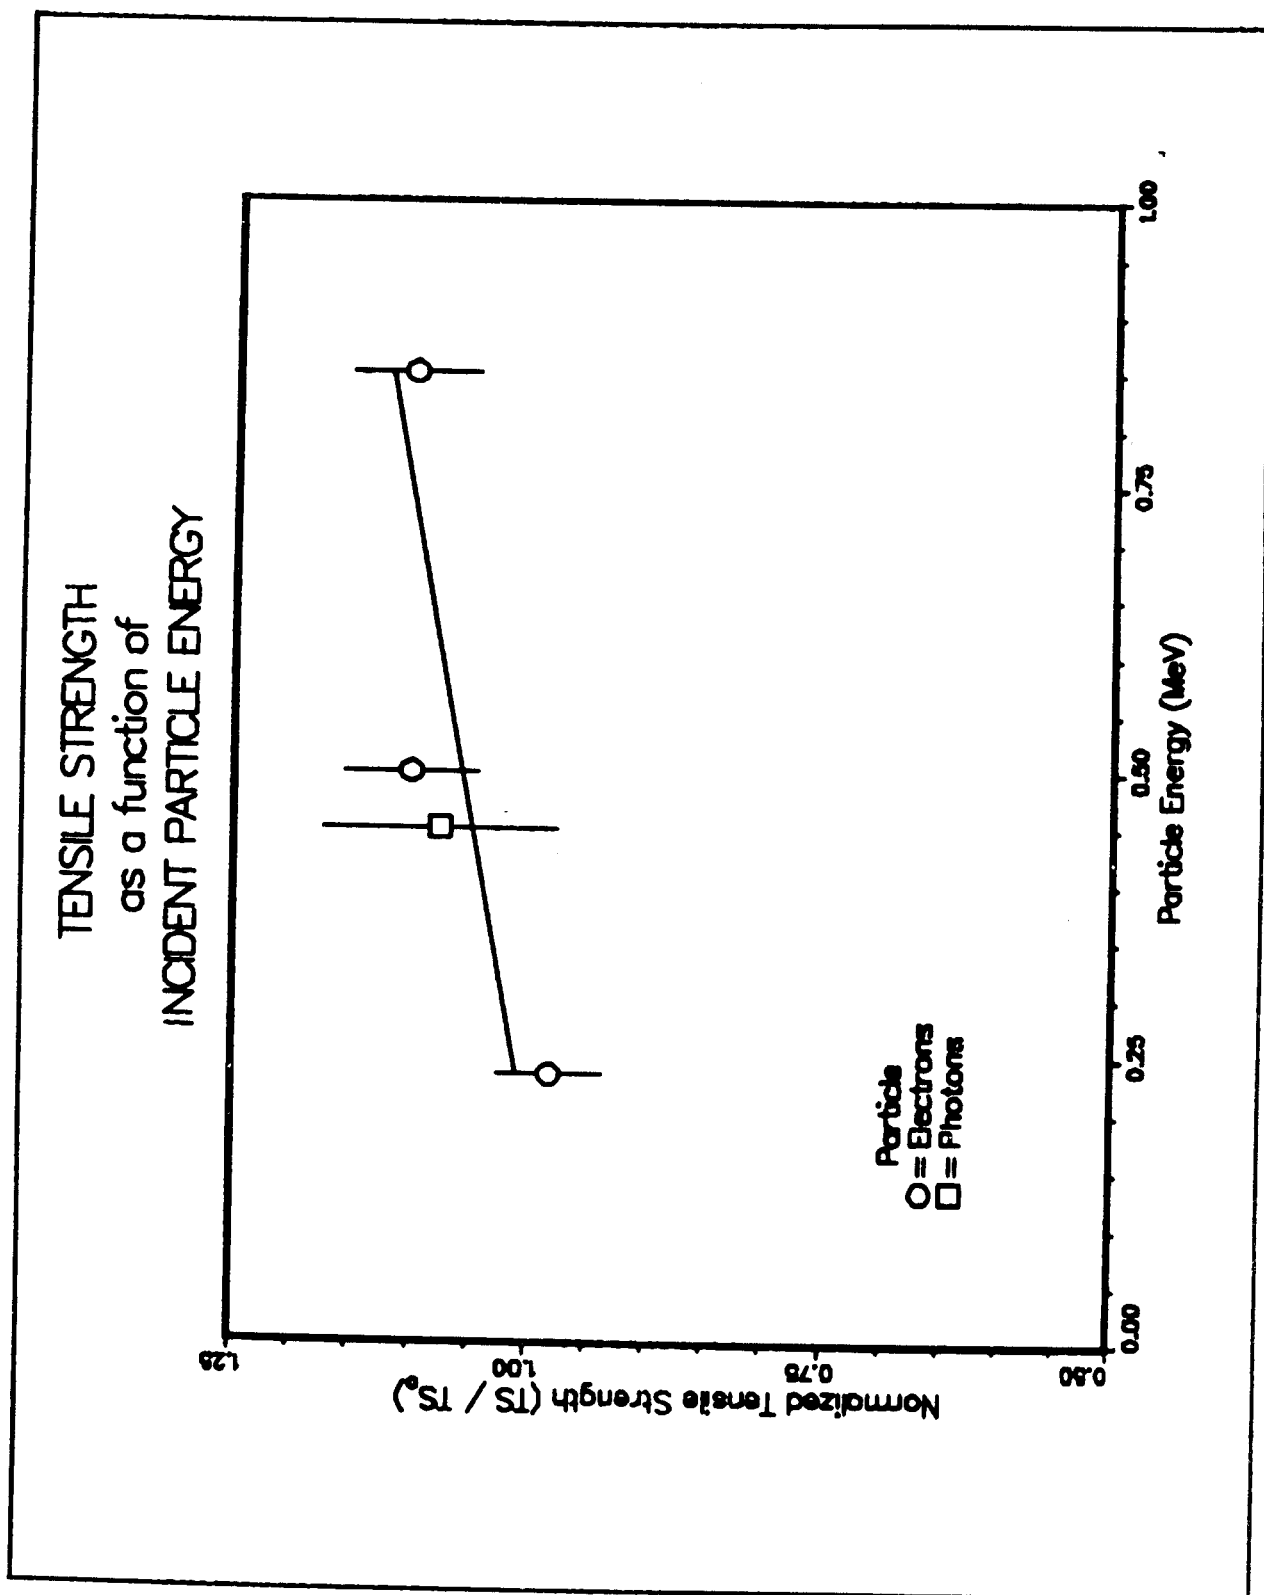


Figure 7: Material Tensile Strength versus Particle Energy-Averaged Data

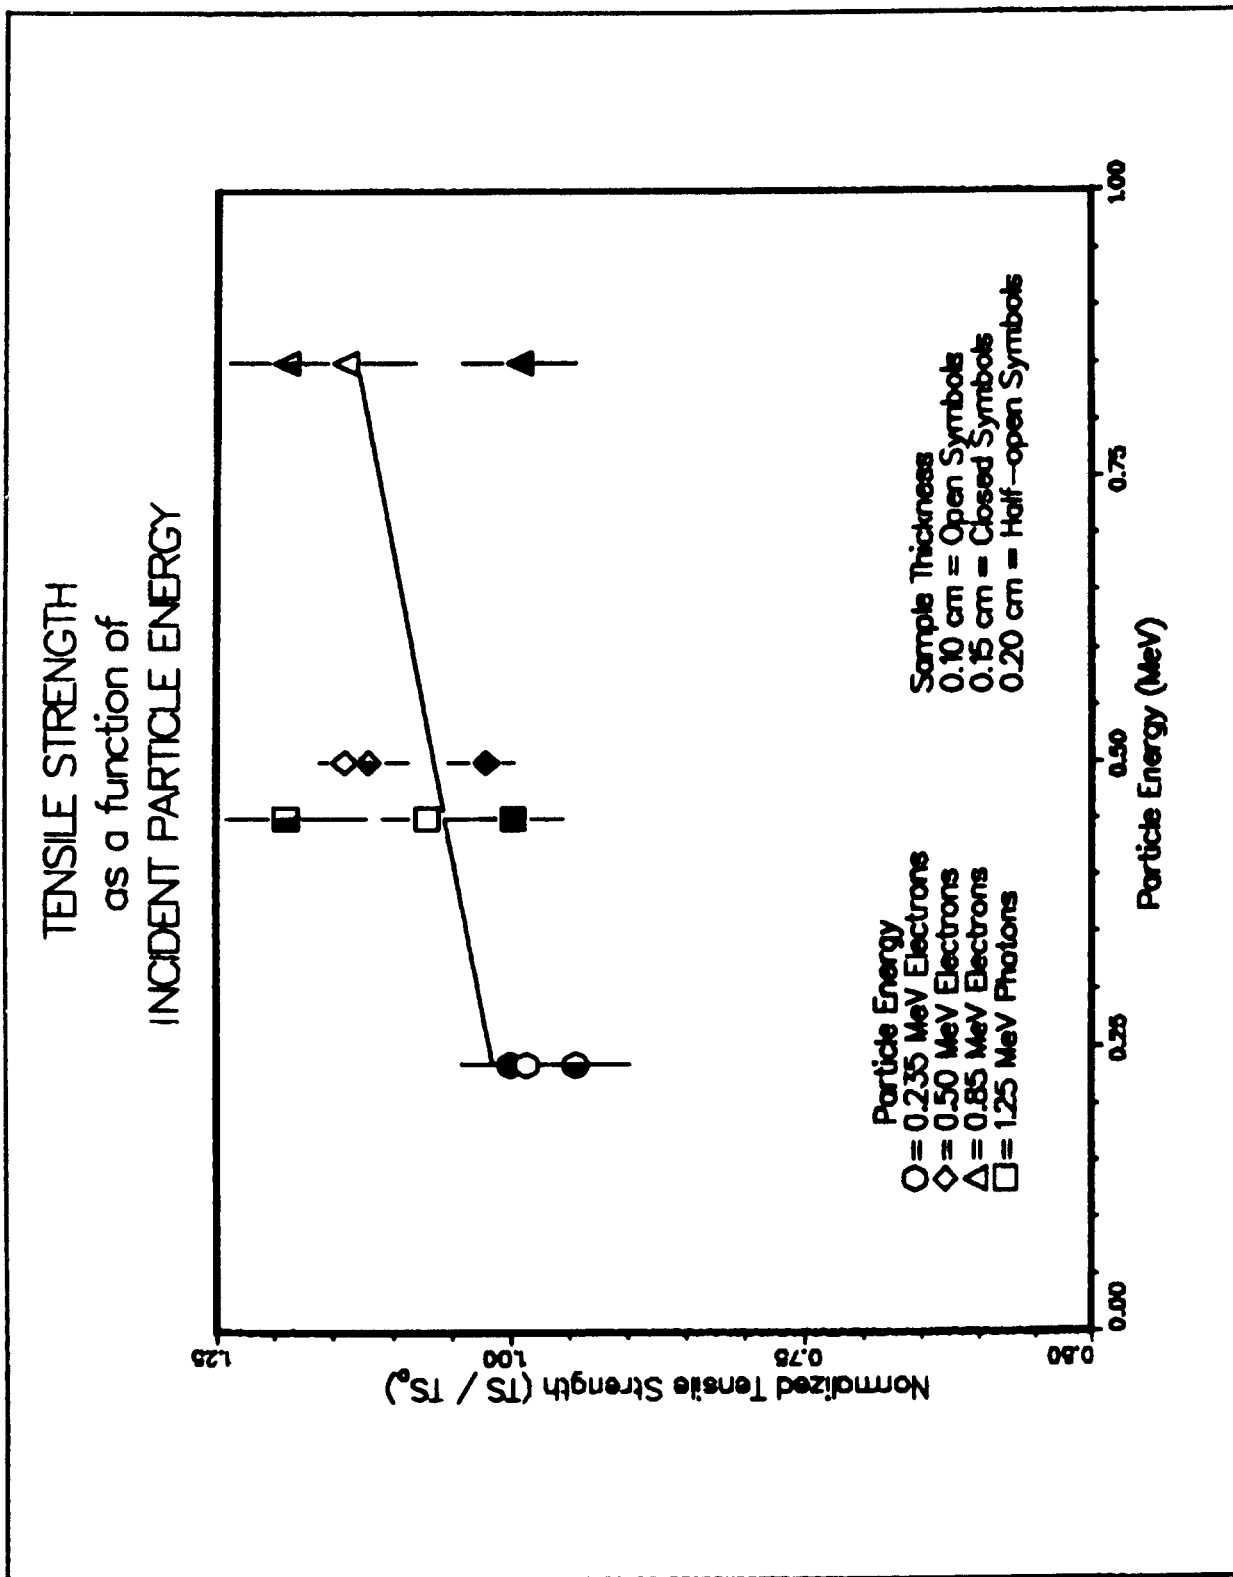


Figure 8: Material Tensile Strength versus Particle Energy

were plotted as a function of energy absorbed in the material sample. Absorbed energy estimates for the three sample thicknesses were obtained with the TIGER code and are listed in Table 2.

Material elongation data as a function of calculated absorbed energy (Table 2) are plotted in Figure 9. Plotted are data for all particle energies and material thicknesses. Symbols are as described earlier with symbol shading being indicative of material thickness. The solid curve is an estimate of the trend in elongation as a function of absorbed energy. As may be observed in the plot elongation, degradation, is a weakly dependent function of absorbed energy per sample thickness and (largely) independent of incident particle type and deposition profile shape.

The tensile strength versus absorbed energy data are presented in Figure 10. These data are consistent with the elongation data of Figure 9 in that tensile strength is a weakly dependent function of absorbed energy and (largely) independent of both incident particle type and energy deposition profile shape.

### 3.3 Elongation and Tensile Strength versus Front Surface Dose

Elongation and tensile strength data, as a function of front surface dose, are presented in Figures 11 and 12. Front surface dose estimates were obtained from an extrapolation of the TIGER calculations to "zero" material thickness and are compiled in Table 3. As in the case of the absorbed energy presentations, symbol shading is indicative of material thickness and the solid curve is an estimate of data trend. From the data presented in Figure 11, we note that elongation is (weakly) dependent on the extrapolated front surface dose, decreasing with increasing front surface dose. From Figure 12 we note that the tensile strength data exhibits a similar behavior in that tensile strength is (weakly) dependent on the extrapolated front surface dose. Finally, neither plot suggests a strong dependence on particle type.

### 3.4 Photon to Electron Relative Effectiveness Estimates

The relative effectiveness of photon and electron radiation exposures to produce material degradation was estimated on the basis of the experimental elongation and tensile strength data. Effectiveness data were derived from the trend estimates of the various elongation and tensile strength data and are based on all particle energies and material thicknesses studied here.

# ELONGATION as a function of ABSORBED ENERGY

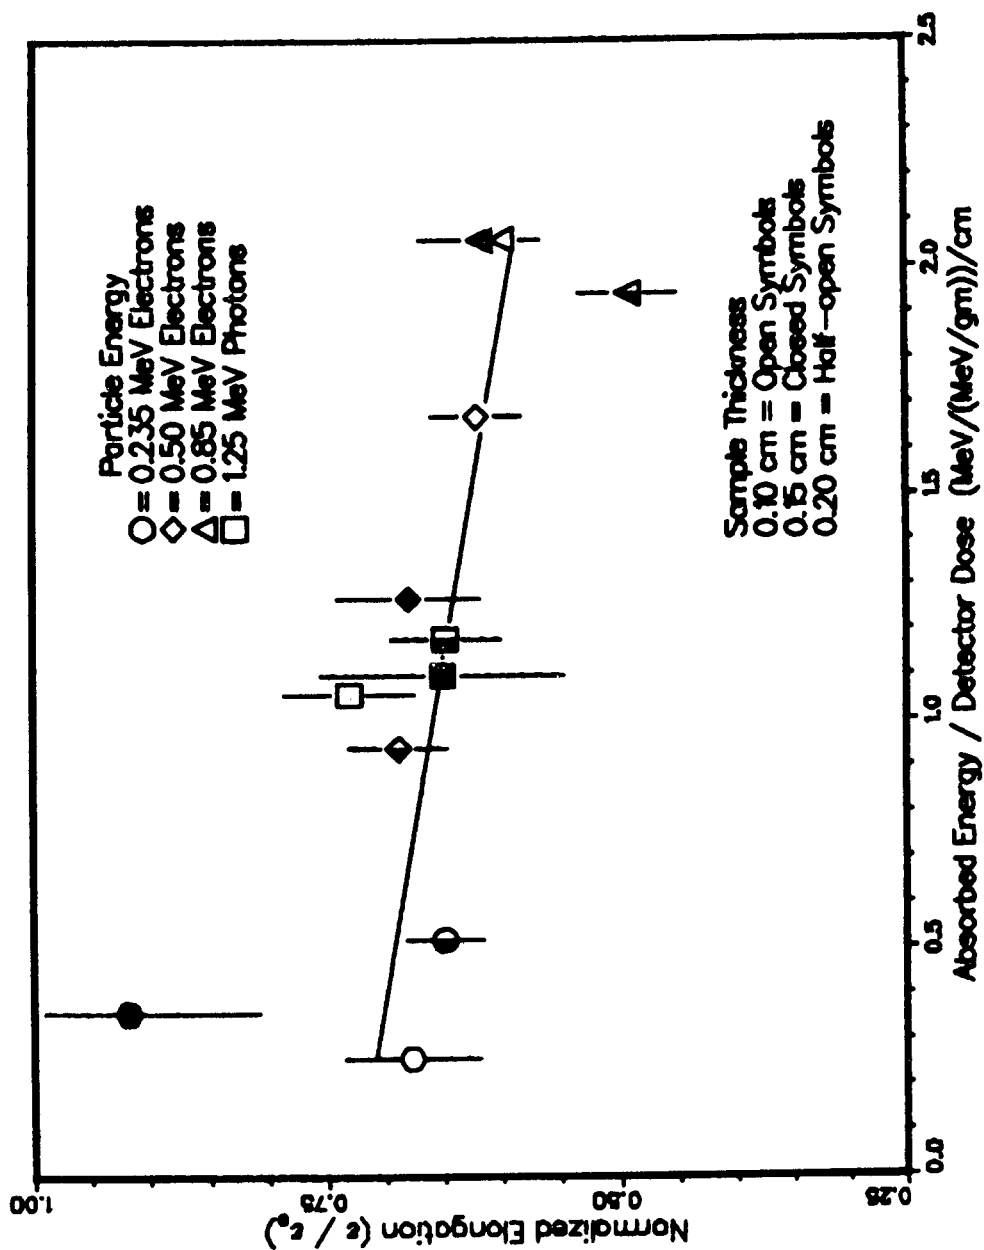


Figure 9: Material Elongation versus Absorbed Energy

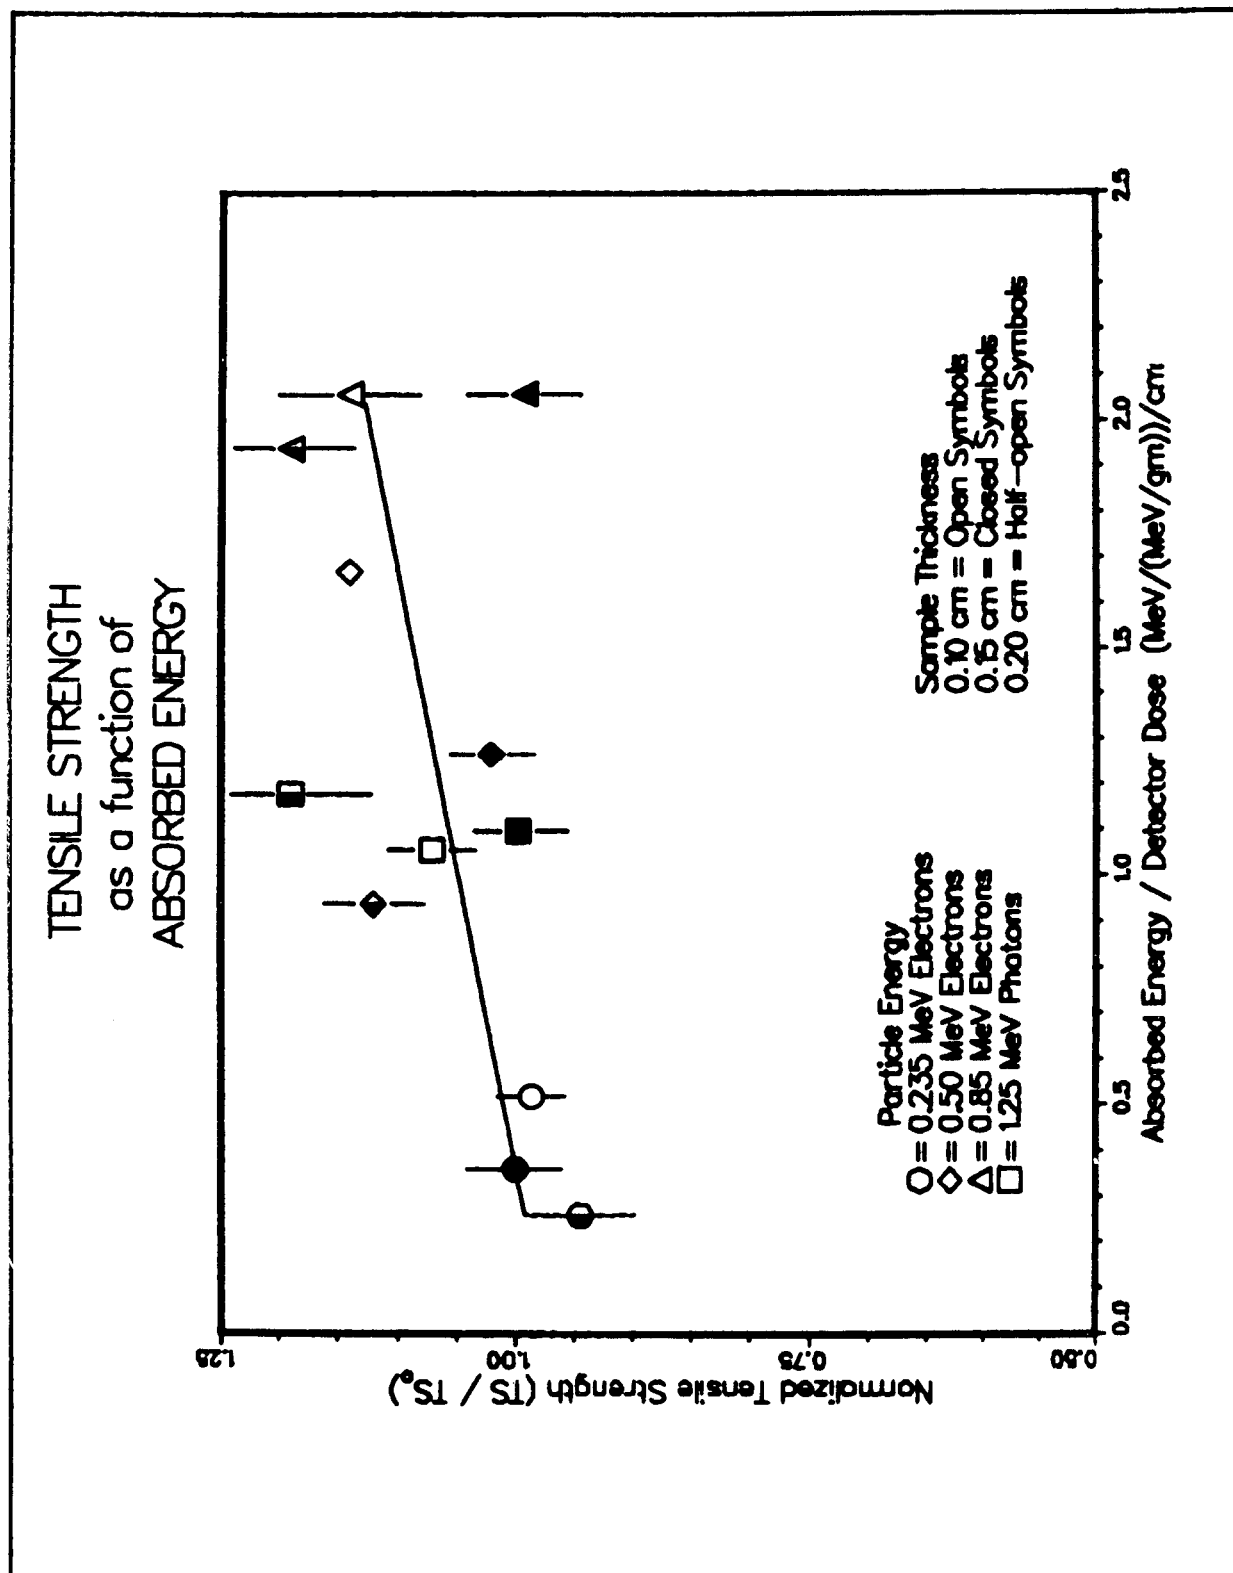


Figure 10: Material Tensile Strength versus Absorbed Energy

# ELONGATION as a function of FRONT SURFACE DOSE

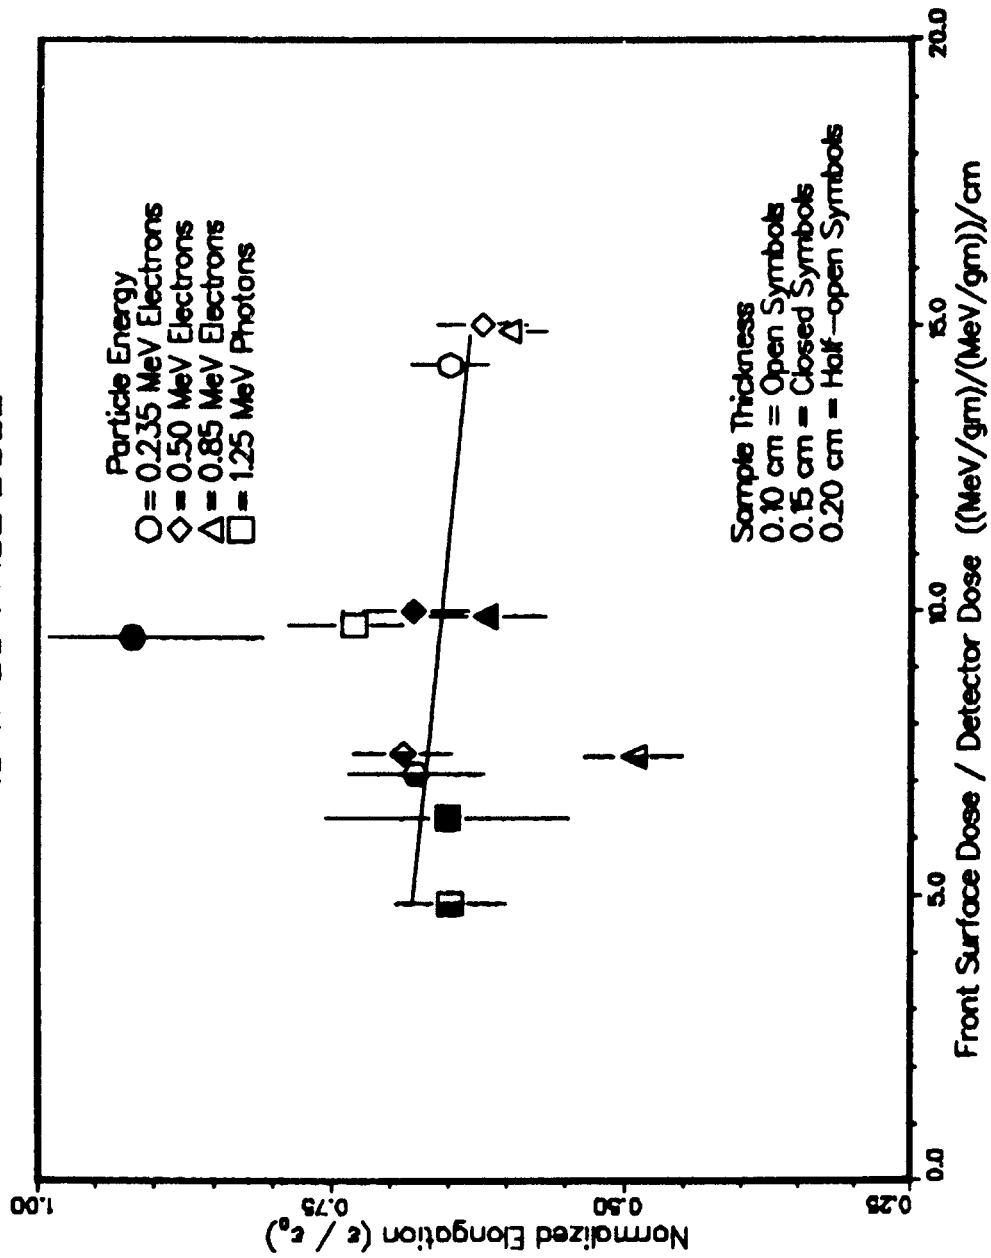


Figure 11: Material Elongation versus Front Surface Dose



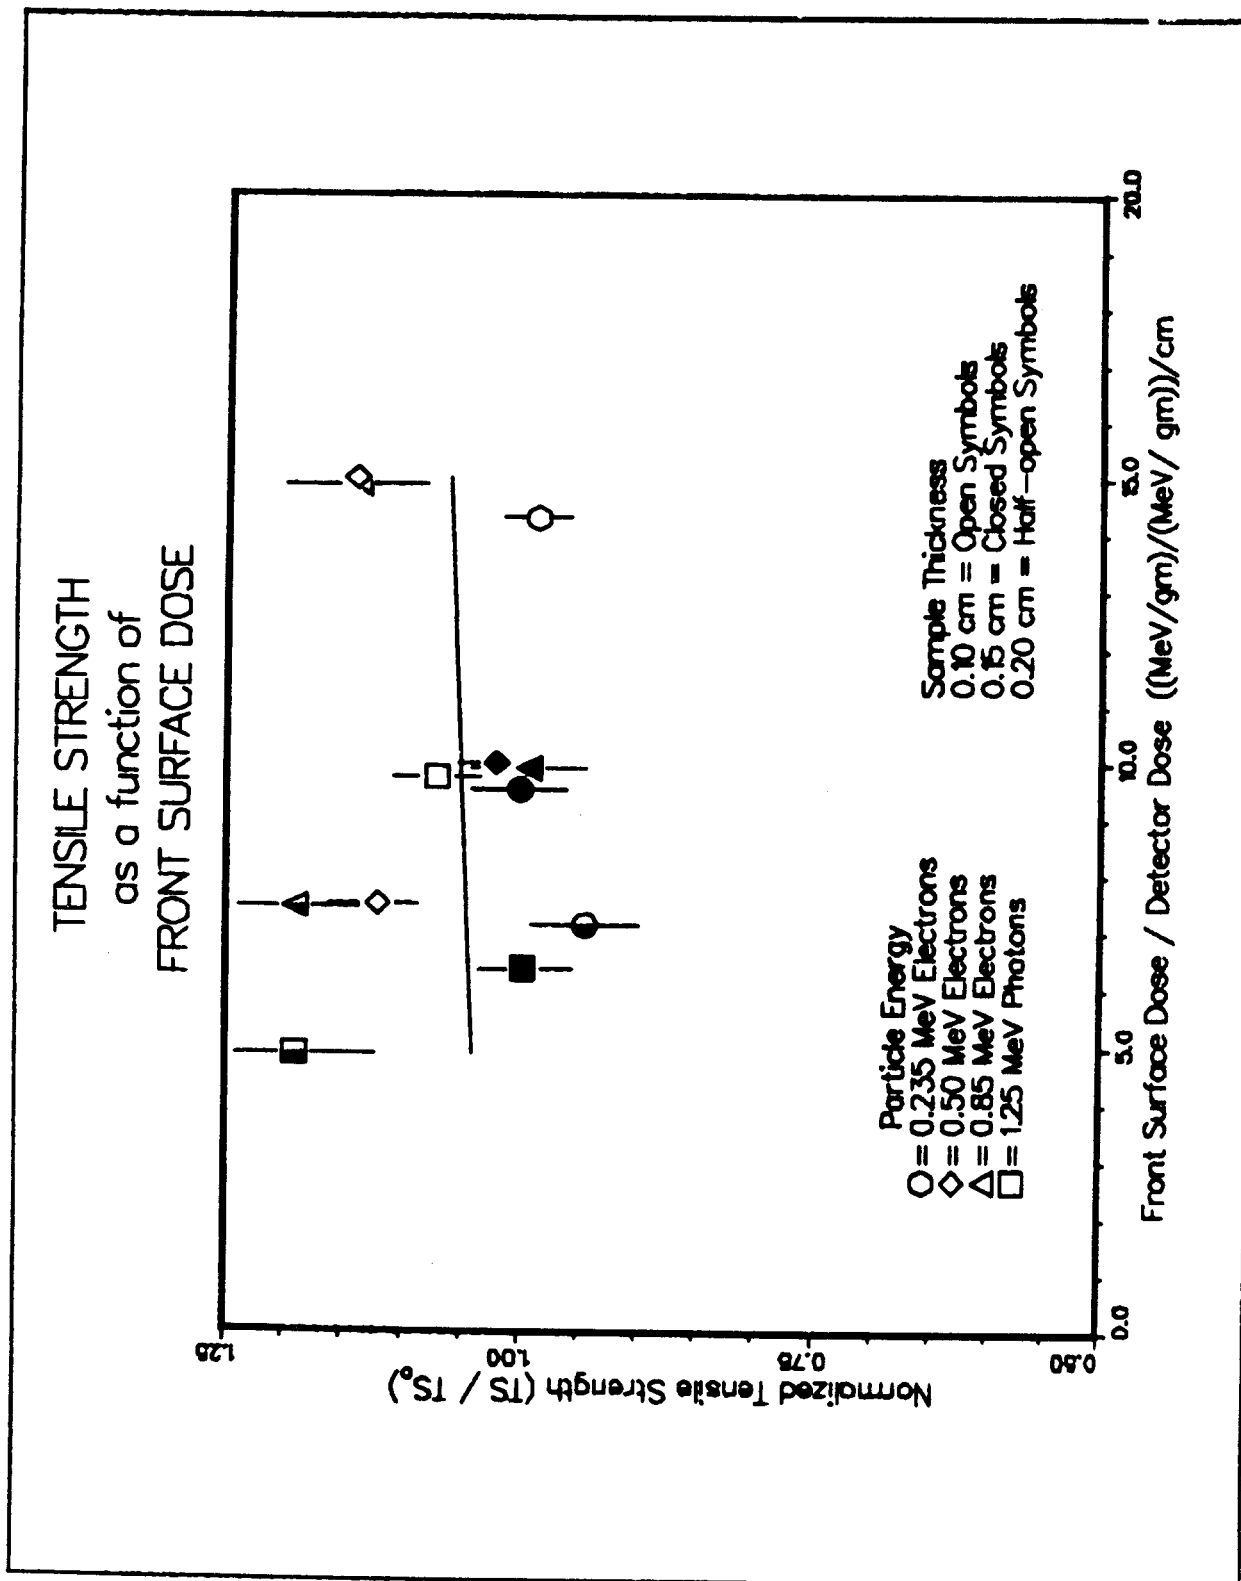


Figure 12: Material Tensile Strength versus Front Surface Dose

In Figure 13 the photon ( $\text{Co}^{60}$ ) to electron effectiveness ratio derived on the basis of elongation data is presented. Effectiveness as a function of particle energy, absorbed energy, and front surface dose is depicted respectively by the circle, diamond, and triangle symbols. The solid curve is the simple average of the three approximations. We note that the effectiveness ratio is a slowly varying function of electron energy and lies in the range  $1.0 \pm 0.07$  for all electron energies considered. Relative effectiveness values derived on the basis of tensile strength data are presented in Figure 14. These values are in good agreement with those based on the elongation data and also predict an effectiveness ratio that is weakly dependent on electron energy. The effectiveness ratio estimated on the basis of tensile strength data is also defined in the band of  $1.0 \pm 0.07$  for all electron energies.

#### 4. CONCLUSIONS

As part of a simulator adequacy study, we have begun the study of the relative effectiveness of electrons and photons in producing radiation damage in a generic EPR rubber insulation material. The program was limited in extent in that a single material was used; however, three material thicknesses were selected so that a realistic range in insulation thicknesses was used in the study. The electron beam energies were selected to adequately span the LOCA estimate of average electron energies. A cobalt-60 irradiator was used to provide the photon irradiations. The study used elongation and tensile strength as indicators of radiation damage. For electron-photon equivalence purposes the damage indicators--elongation and tensile strength--were then equated to calculated values of average particle energy, material front surface dose, and absorbed energy.

Using this technique, we observed that material damage indicators were smoothly varying functions of incident electron average energy, total absorbed energy, and front surface dose. In all instances photon induced material changed tracked with the electron values--in agreement with the concept of photon-electron damage equivalence. Combined electron and photon data demonstrate that material damage, as indicated by elongation and tensile strength changes, is a slowly varying function of particle energy, absorbed energy, and front surface dose. Material thickness data indicates that, for the energies and thicknesses considered, the energy deposition distribution within the sample is not significant; rather, damage is a function only of total energy absorbed. Photon-electron relative effectiveness data, derived from the analysis of elongation and tensile strength information, predicts that photon to electron equivalence is a

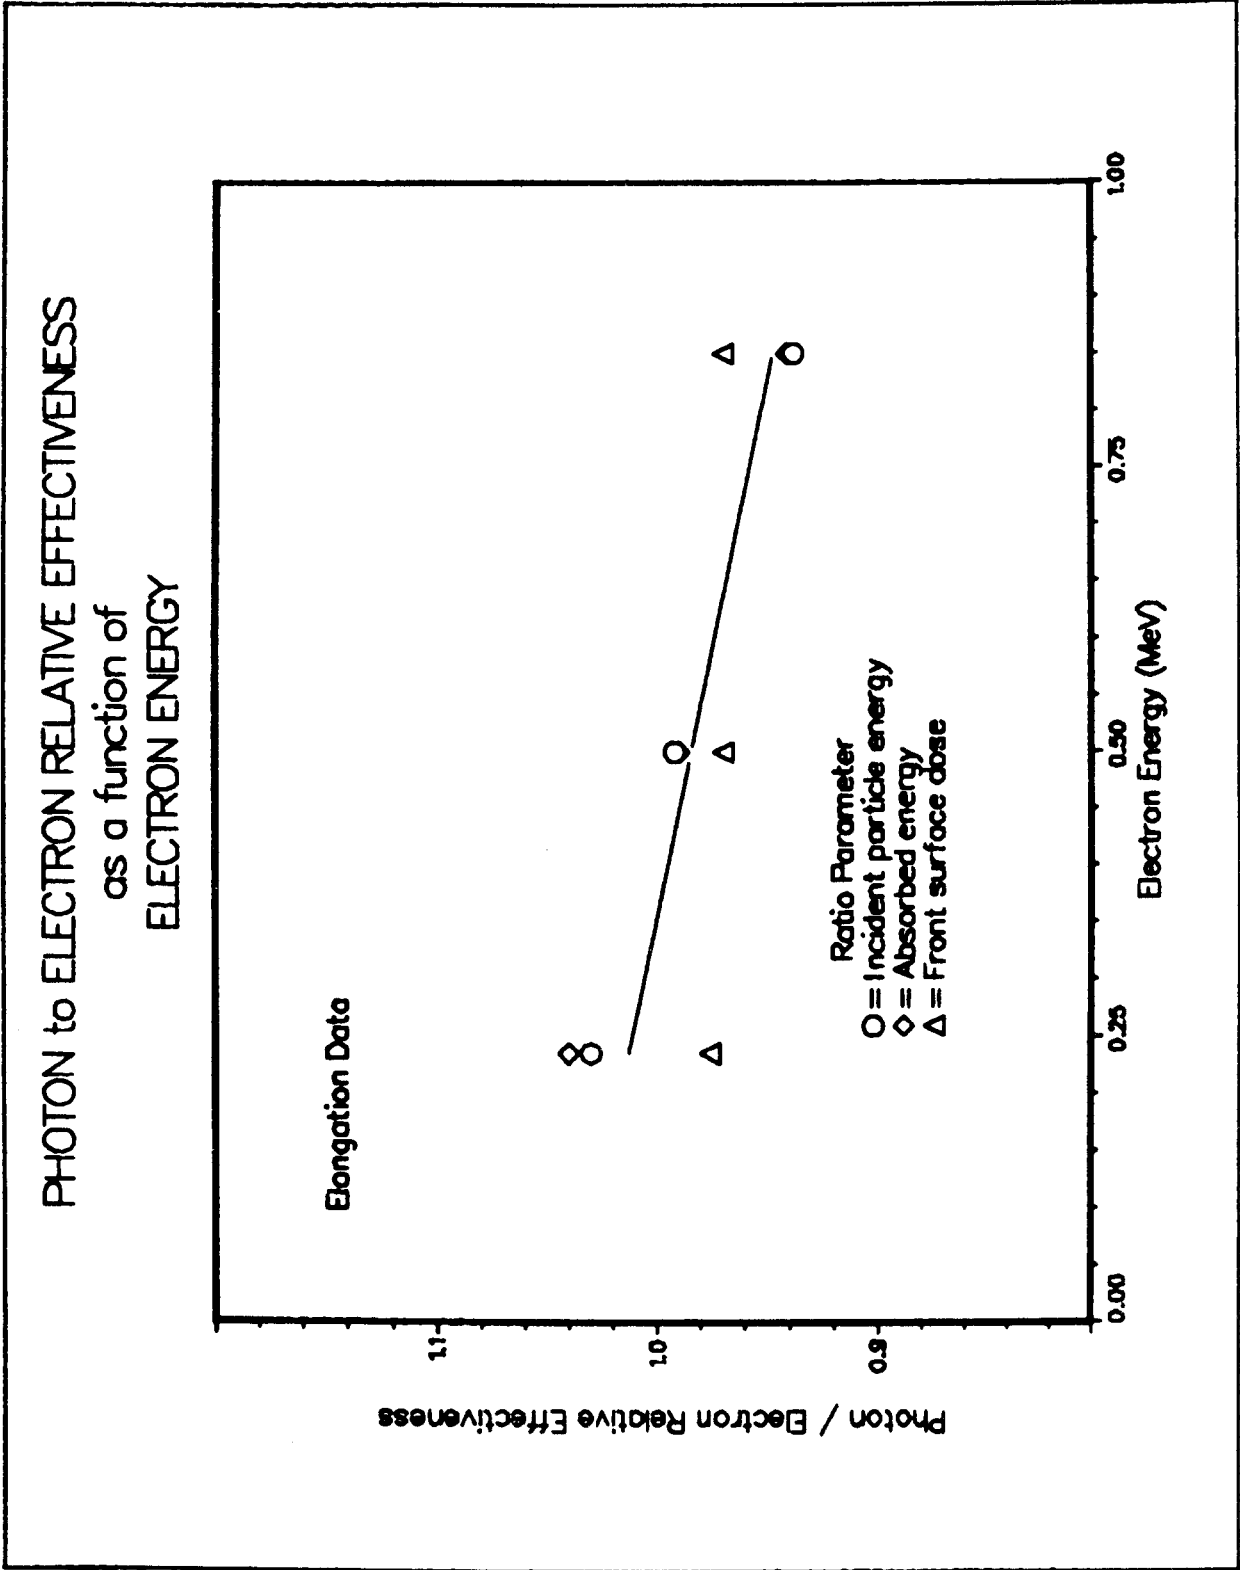


Figure 13: Photon to Electron Effectiveness Ratio-Elongation Estimate

# PHOTON to ELECTRON RELATIVE EFFECTIVENESS as a function of ELECTRON ENERGY

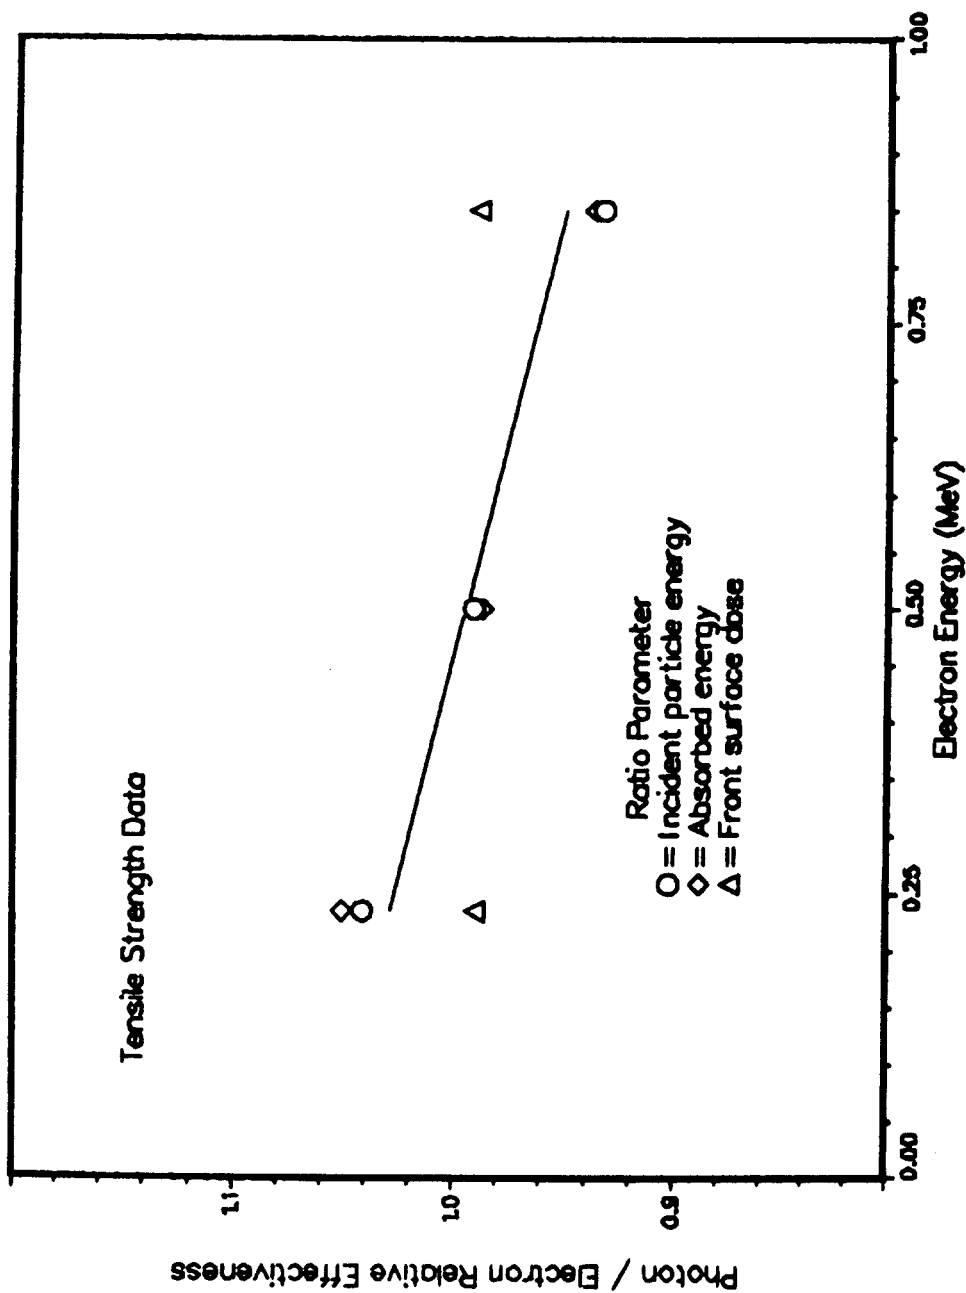


Figure 14: Photon to Electron Effectiveness Ratio-Tensile Strength Estimate

linear function of incident electron energy and that incident particle energy, absorbed energy, and front surface dose are equally dependable estimations of photon and electron equivalence. From a practical point of view, front surface dose measurements may provide the most straightforward method of comparing electron and photon effects experiments.

Although the equivalence between photon and electron irradiations has been demonstrated on the basis of these experiments, it is believed additional studies are warranted. In addition to considering another, higher integrated dose, we believe the program should be extended to include at least one other material formulation as a test to the uniqueness of these results. Further, lower energy electron beam irradiations should be considered so that the effects, if any, of energy deposition profile could be examined further. This effort might establish a lower, practical limit on the LOCA electron spectrum. Finally, we are aware that dose-rate effects are influencing the results presented in this report. It may be observed from Figures 4 and 9 (or 10) that, for a constant detector dose, as electron energy is increased dose per unit (material) thickness, integrated dose, and dose rate in the material interior will also increase. From data not tabulated here, we noted that material response is a sensitive function of dose-rate, as determined with the detector for dose-rates below 2 to 3 Mrad/hr. It is suggested that this dose-rate dependence results in a decrease in the effectiveness of higher energy electrons thus flattening the response (as a function of energy) curves. Although the dose rate used in this study is representative of LOCA dose rates, further work at other dose rates necessary to more adequately investigate the dose-rate effects on the effectiveness of higher energy electrons may be warranted.

## REFERENCES

1. L. L. Bonzon and W. H. Buckalew, Evaluation of Simulator Adequacy for the Radiation Qualification of Safety Related Equipment, SAND79-1787, NUREG/CR-1184, Sandia National Laboratories, January 1980.
2. E. A. Salazar, D. A. Bouchard, and D. T. Furgal, Aging with Respect to Flammability and Other Properties in Fire-Retarded Ethylene Propylene Rubber and Chlorosulfonated Polyethylene, SAND81-1906, NUREG/CR-2314, Sandia National Laboratories, March 1982.
3. L. L. Bonzon, N. A. Lurie, D. H. Houston, and J. A. Nuber, Definition of Loss of Coolant Accident Radiation Source: Summary and Conclusions, SAND78-0091, Sandia National Laboratories, May 1976.
4. L. L. Bonzon, Radiation Signature Following the Hypothesized LOCA, SAND76-0740, NUREG76-6521, Sandia National Laboratories, Rev. October 1977.
5. G. H. Miller and G. J. Lockwood, IEEE Trans. Nucl. Sci., NS-22, 1072 (1975).
6. W. H. Buckalew, G. J. Lockwood, S. M. Luker, L. E. Ruggles, F. J. Wyant, Capabilities and Diagnostics of the Sandia Pelletron-Raster System, SAND84-0912, NUREG/CR-3777, Sandia National Laboratories, July, 1984.
7. J. A. Halbleib, Sr., and W. H. Vandevender, Nucl. Sci. Eng., 57, 94 (1975).

**DISTRIBUTION:**

U.S. Government Printing Office  
Receiving Branch (Attn: NRC Stock)  
8610 Cherry Lane  
Laurel, MD 20707  
375 copies for RV

Ansaldo Impianti  
Centro Sperimentale del Boschetto  
Corso F.M. Perrone, 118  
16161 Genova  
ITALY  
Attn: C. Bozzolo

Ansaldo Impianti  
Via Gabriele D'Annunzio, 113  
16121 Genova  
ITALY  
Attn: S. Grifoni

ASEA-ATOM  
Department KRD  
Box 53  
S-721 04  
Vasteras  
SWEDEN  
Attn: A. Kjellberg

ASEA-ATOM  
Department TQD  
Box 53  
S-721 04  
Vasteras  
SWEDEN  
Attn: T. Granberg

ASEA KABEL AB  
P.O. Box 42 108  
S-126 12  
Stockholm  
SWEDEN  
Attn: B. Dellby

Atomic Energy of Canada, Ltd.  
Chalk River Nuclear Laboratories  
Chalk River, Ontario K0J 1J0  
CANADA  
Attn: G. F. Lynch

Atomic Energy of Canada, Ltd.  
1600 Dorchester Boulevard West  
Montreal, Quebec H3H 1P9  
CANADA  
Attn: S. Nish

Atomic Energy Research Establishment  
Building 47, Division M.D.D.  
Harwell, Oxfordshire  
OX11 0RA,  
ENGLAND  
Attn: S. G. Burnay

Bhabha Atomic Research Centre  
Health Physics Division  
BARC  
Bombay-85  
INDIA  
Attn: S. K. Mehta

British Nuclear Fuels Ltd.  
Springfields Works  
Salwick, Preston  
Lancs  
ENGLAND  
Attn: W. G. Cunliff, Bldg 334

Brown Boveri Reaktor GMBH  
Postfach 5143  
D-6800 Mannheim 1  
WEST GERMANY  
Attn: R. Schemmel

Bundesanstalt fur Materialprufung  
Unter den Eichen 87  
D-1000 Berlin 45  
WEST GERMANY  
Attn: K. Wundrich

CEA/CEN-FAR  
Departement de Surete Nucleaire  
Service d'Analyse Fonctionnelle  
B.P. 6  
92260 Fontenay-aux-Roses  
FRANCE  
Attn: M. Le Meur  
J. Henry

CERN  
Laboratoire 1  
CH-1211 Geneve 23  
SWITZERLAND  
Attn: H. Schonbacher

Canada Wire and Cable Limited  
Power & Control Products Division  
22 Commercial Road  
Toronto, Ontario  
CANADA M4G 1Z4  
Attn: Z. S. Paniri

Centro Elettrotecnico  
Sperimentale Italiano  
Research and Development  
Via Rubattino 54  
20134 Milan,  
ITALY  
Attn: Carlo Masetti

Commissariat a l'Energie Atomique  
ORIS/LABRA  
BP N° 21  
91190 Gif-Sur-Yvette  
FRANCE  
Attn: G. Gaussens  
J. Chenion  
F. Carlin

Commissariat a l'Energie Atomique  
CEN Cadarche DRE/STRE  
BP N° 1  
13115 Saint Paul Lez Durance  
FRANCE  
Attn: J. Campan

Conductores Monterrey, S. A.  
P.O. Box 2039  
Monterrey, N. L.  
MEXICO  
Attn: P. G. Murga

Electricite de France  
(S.E.P.T.E.N.)  
12, 14 Ave. Dubrieroz  
69628 Villeurbarnie  
Paris, FRANCE  
Attn: H. Herouard  
M. Hermant

Electricite de France  
Direction des Etudes et Recherches  
1, Avenue du General de Gaulle  
92141 CLAMART CEDEX  
FRANCE  
Attn: J. Roubault  
L. Deschamps

Electricite de France  
Direction des Etudes et Recherches  
Les Renardieres  
Boite Postale n° 1  
77250 MORET SUR LORING  
FRANCE  
Attn: Ph. Roussarie  
V. Deglon  
J. Ribot

Energia Nucleare e delle  
Energie Alternative  
CKE Casaccia  
I-0060 Rome  
ITALY  
Attn: A. Cabrini

EURATOM  
Commission of European Communities  
C.E.C. J.R.C.  
21020 Ispra (Varese)  
ITALY  
Attn: G. Mancini

FRAMATOME  
Tour Fiat - Cedex 16  
92084 Paris La Defense  
FRANCE  
Attn: G. Chauvin  
E. Raimondo

Furukawa Electric Co., Ltd.  
Hiratsuka Wire Works  
1-9 Higashi Yawata - 5 Chome  
Hiratsuka, Kanagawa Pref  
JAPAN 254  
Attn: E. Oda

Gesellschaft fur Reaktorsicherheit (GRS) mbH  
Glockengasse 2  
D-5000 Koln 1  
WEST GERMANY  
Attn: Library



Health & Safety Executive  
Thames House North  
Milbank  
London SW1P 4QJ  
ENGLAND  
Attn: W. W. Ascroft-Hutton

ITT Cannon Electric Canada  
Four Cannon Court  
Whitby, Ontario L1N 5V8  
CANADA  
Attn: B. D. Vallillee

Imatran Voima Oy  
Electrotechn. Department  
P.O. Box 138  
SF-00101 Helsinki 10  
FINLAND  
Attn: B. Regnell  
K. Koskinen

Institute of Radiation Protection  
Department of Reactor Safety  
P.O. Box 268  
00101 Helsinki 10  
FINLAND  
Attn: L. Reiman

Instituto de Desarrollo y Diseno  
Ingar - Santa Fe  
Avellaneda 3657  
C.C. 34B  
3000 Santa Fe  
REPUBLICA ARGENTINA  
Attn: N. Labath

ISMES S.p.A.  
Viale G. Cesare, 29  
24100 BERGAMO, Italy  
Attn: A. Castoldi  
M. Salvetti

Japan Atomic Energy Research Institute  
Takasaki Radiation Chemistry  
Research Establishment  
Watanuki-machi  
Takasaki, Gunma-ken  
JAPAN  
Attn: N. Tamura  
K. Yoshida  
T. Seguchi

Japan Atomic Energy Research Institute  
Tokai-Mura  
Naka-Gun  
Ibaraki-Ken  
319-11, JAPAN  
Attn: Y. Koizumi

Japan Atomic Energy Research Institute  
Osaka Laboratory for Radiation Chemistry  
25-1 Mii-Minami machi,  
Neyagawa-shi  
Osaka 572  
JAPAN  
Attn: Y. Nakase

Kalle Niederlassung der Hoechst AG  
Postfach 3540  
6200 Wiesbaden 1,  
WEST GERMANY  
Biebrich  
Attn: Dr. H. Wilski

Kraftwerk Union AG  
Department R361  
Hammerbacherstrasse 12 + 14  
D-8524 Erlangen  
WEST GERMANY  
Attn: I. Terry

Kraftwerk Union AG  
Section R541  
Postfach: 1240  
D-8757 Karlstein  
WEST GERMANY  
Attn: W. Siegler

Kraftwerk Union AG  
Hammerbacherstrasse 12 + 14  
Postfach: 3220  
D-8520 Erlangen  
WEST GERMANY  
Attn: W. Morell

Motor Columbus  
Parkstrasse 27  
CH-5401  
Baden  
SWITZERLAND  
Attn: H. Fuchs

National Nuclear Corporation  
Cambridge Road, Whetstone  
Leicester LE8 3LH  
ENGLAND  
Attn: A. D. Hayward  
J. V. Tindale

NOK AG Baden  
Beznau Nuclear Power Plant  
CH-5312 Doettingen  
SWITZERLAND  
Attn: O. Tatti

Norsk Kabelfabrik  
3000 Drammen  
NORWAY  
Attn: C. T. Jacobsen

Nuclear Power Engineering Test Center  
6-2, Toranomon, 3-Chome  
Minato-ku, #2 Akiyana Bldg.  
Tokyo 105  
JAPAN  
Attn: K. Takumi

Ontario Hydro  
700 University Avenue  
Toronto, Ontario M5G 1X6  
CANADA  
Attn: R. Wong  
B. Kukreti

Oy Stromberg Ab  
Helsinki Works  
Box 118  
FI-00101 Helsinki 10  
FINLAND  
Attn: P. Paloniemi

Radiation Center of  
Osaka Prefecture  
Radiation Application-  
Physics Division  
Shinke-Cho, Sakai  
Osaka, 593, JAPAN  
Attn: S. Okamoto

Rappinl  
ENEA-PEC  
Via Arcoveggio 56/23  
Bologna  
ITALY  
Attn: Ing. Ruggero

Rheinisch-Westfallscher  
Technischer Überwachungs-Verein e.V.  
Postfach 10 32 61  
D-4300 Essen 1  
WEST GERMANY  
Attn: R. Sartori

Sydkraft  
Southern Sweden Power Supply  
21701 Malmo  
SWEDEN  
Attn: O. Grondalen

Technical University Munich  
Institut for Radiochemie  
D-8046 Garching  
WEST GERMANY  
Attn: Dr. H. Heusinger

UKAEA  
Materials Development Division  
Building 47  
AERE Harwell  
OXON OX11 0RA  
ENGLAND  
Attn: D. C. Phillips

United Kingdom Atomic Energy Authority  
Safety & Reliability Directorate  
Wigshaw Lane  
Culcheth  
Warrington WA3 4NE  
ENGLAND  
Attn: M. A. H. G. Alderson

Waseda University  
Department of Electrical Engineering  
3-4-1 Ohkubo, Shinjuku-ku  
Tokyo 160  
JAPAN  
Attn: Y. Ohki

1200	J. P. VanDevender
1231	J. A. Halbleib
1234	G. J. Lockwood
1800	R. L. Schwoebel
1810	R. G. Kepler
1811	R. L. Clough
1812	J. M. Zeigler
1812	K. T. Gillen
1813	J. G. Curro
2126	J. E. Gover
2126	O. M. Stuetzer
6200	V. L. Dugan
6300	R. W. Lynch
6400	A. W. Snyder
6410	J. W. Hickman
6417	D. D. Carlson
6420	J. V. Walker
6433	F. V. Thome
6440	D. A. Dahlgren
6442	W. A. Von Rieseemann
6444	L. D. Buxton
6446	L. L. Bonzon (10)
6446	W. H. Buckalew (5)
6446	L. D. Bustard
6446	J. W. Grossman
6446	M. J. Jacobus
6446	J. D. Keck
6446	F. J. Wyant
6447	D. L. Berry
6449	K. D. Bergeron
6450	J. A. Reuscher
8024	P. W. Dean
3141	S. A. Landenberger (5)
3151	W. L. Garner



<b>NRC FORM 336</b> (2-84) NRCM 1102, 3201, 3202 <b>BIBLIOGRAPHIC DATA SHEET</b> SEE INSTRUCTIONS ON THE REVERSE		<b>U.S. NUCLEAR REGULATORY COMMISSION</b>		<b>1. REPORT NUMBER (Assigned by TIDC, add Vol. No., if any)</b> NUREG/CR-4543 SAND86-0462					
<b>2. TITLE AND SUBTITLE</b> First Results from Electron-Photon Damage Equivalence Studies on a Generic Ethylene- Propylene Rubber			<b>3. LEAVE BLANK</b>						
<b>5. AUTHOR(S)</b> W. H. Buckalew			<b>4. DATE REPORT COMPLETED</b> <table border="1"> <tr> <td>MONTH</td> <td>YEAR</td> </tr> <tr> <td>March</td> <td>1986</td> </tr> </table>			MONTH	YEAR	March	1986
MONTH	YEAR								
March	1986								
<b>7. PERFORMING ORGANIZATION NAME AND MAILING ADDRESS (Include Zip Code)</b> Qualification Methodology Assessment Division 6446 Sandia National Laboratories Albuquerque, NM 87185			<b>6. DATE REPORT ISSUED</b> <table border="1"> <tr> <td>MONTH</td> <td>YEAR</td> </tr> <tr> <td>April</td> <td>1986</td> </tr> </table>			MONTH	YEAR	April	1986
MONTH	YEAR								
April	1986								
<b>10. SPONSORING ORGANIZATION NAME AND MAILING ADDRESS (Include Zip Code)</b> Electrical Engineering Instrumentation and Control Branch, Div. Engineering Technology Office of Nuclear Regulatory Research U.S. Nuclear Regulatory Commission Washington, DC 20555			<b>8. PROJECT TASK WORK UNIT NUMBER</b>  <b>9. FIN OR GRANT NUMBER</b> A-1051						
<b>12. SUPPLEMENTARY NOTES</b>			<b>11a. TYPE OF REPORT</b> Final Report <b>b. PERIOD COVERED (Inclusive dates)</b>						
<b>13. ABSTRACT (200 words or less)</b> <p>As part of a simulator adequacy assessment program, the relative effectiveness of electrons and photons to produce damage in a generic ethylene-propylene rubber (EPR) has been investigated. The investigation was limited in extent in that a single EPR material, in three thicknesses, was exposed to Cobalt-60 photons and three electron beam energies.</p> <p>Basing material damage on changes in the EPR mechanical properties elongation and tensile strength, we observed that EOR damage was a smoothly varying function of absorbed energy and independent of irradiating particle type. EPR damage tracked equally well as a function of both incident particle energy and material front surface dose.</p> <p>Based on these preliminary data, we tentatively concluded that a correlation between particle, particle energy, and material damage (as measured by changes in material elongation and/or tensile strength) has been demonstrated.</p>									
<b>14. DOCUMENT ANALYSIS - a. KEYWORDS/DESCRIPTORS</b>  <b>b. IDENTIFIERS/OPEN-ENDED TERMS</b>				<b>15. AVAILABILITY STATEMENT</b> Unlimited <b>16. SECURITY CLASSIFICATION</b> (This page) Unclassified (This report) Unclassified <b>17. NUMBER OF PAGES</b> 42 <b>18. PRICE</b>					